GENERAL WOOD WALL FRAMING NOTES

1. ALL WOOD TO BE SYP, No.2
2. WOOD IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE TREATED
3. ALL NAILS SHALL BE HOT DIPPED GALVANIZED..
4. ALL PLYWOOD FOR FLOOR SHEATHING SHALL BE ¾" (²³/₃₂") APA RATED EXPOSURE 1 CDX GLUED AND NAILED TO TOP OF WOOD JOISTS WITH ADHESIVES MEETING THE REQUIREMENTS OF AFG-01 AND APPLIED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.

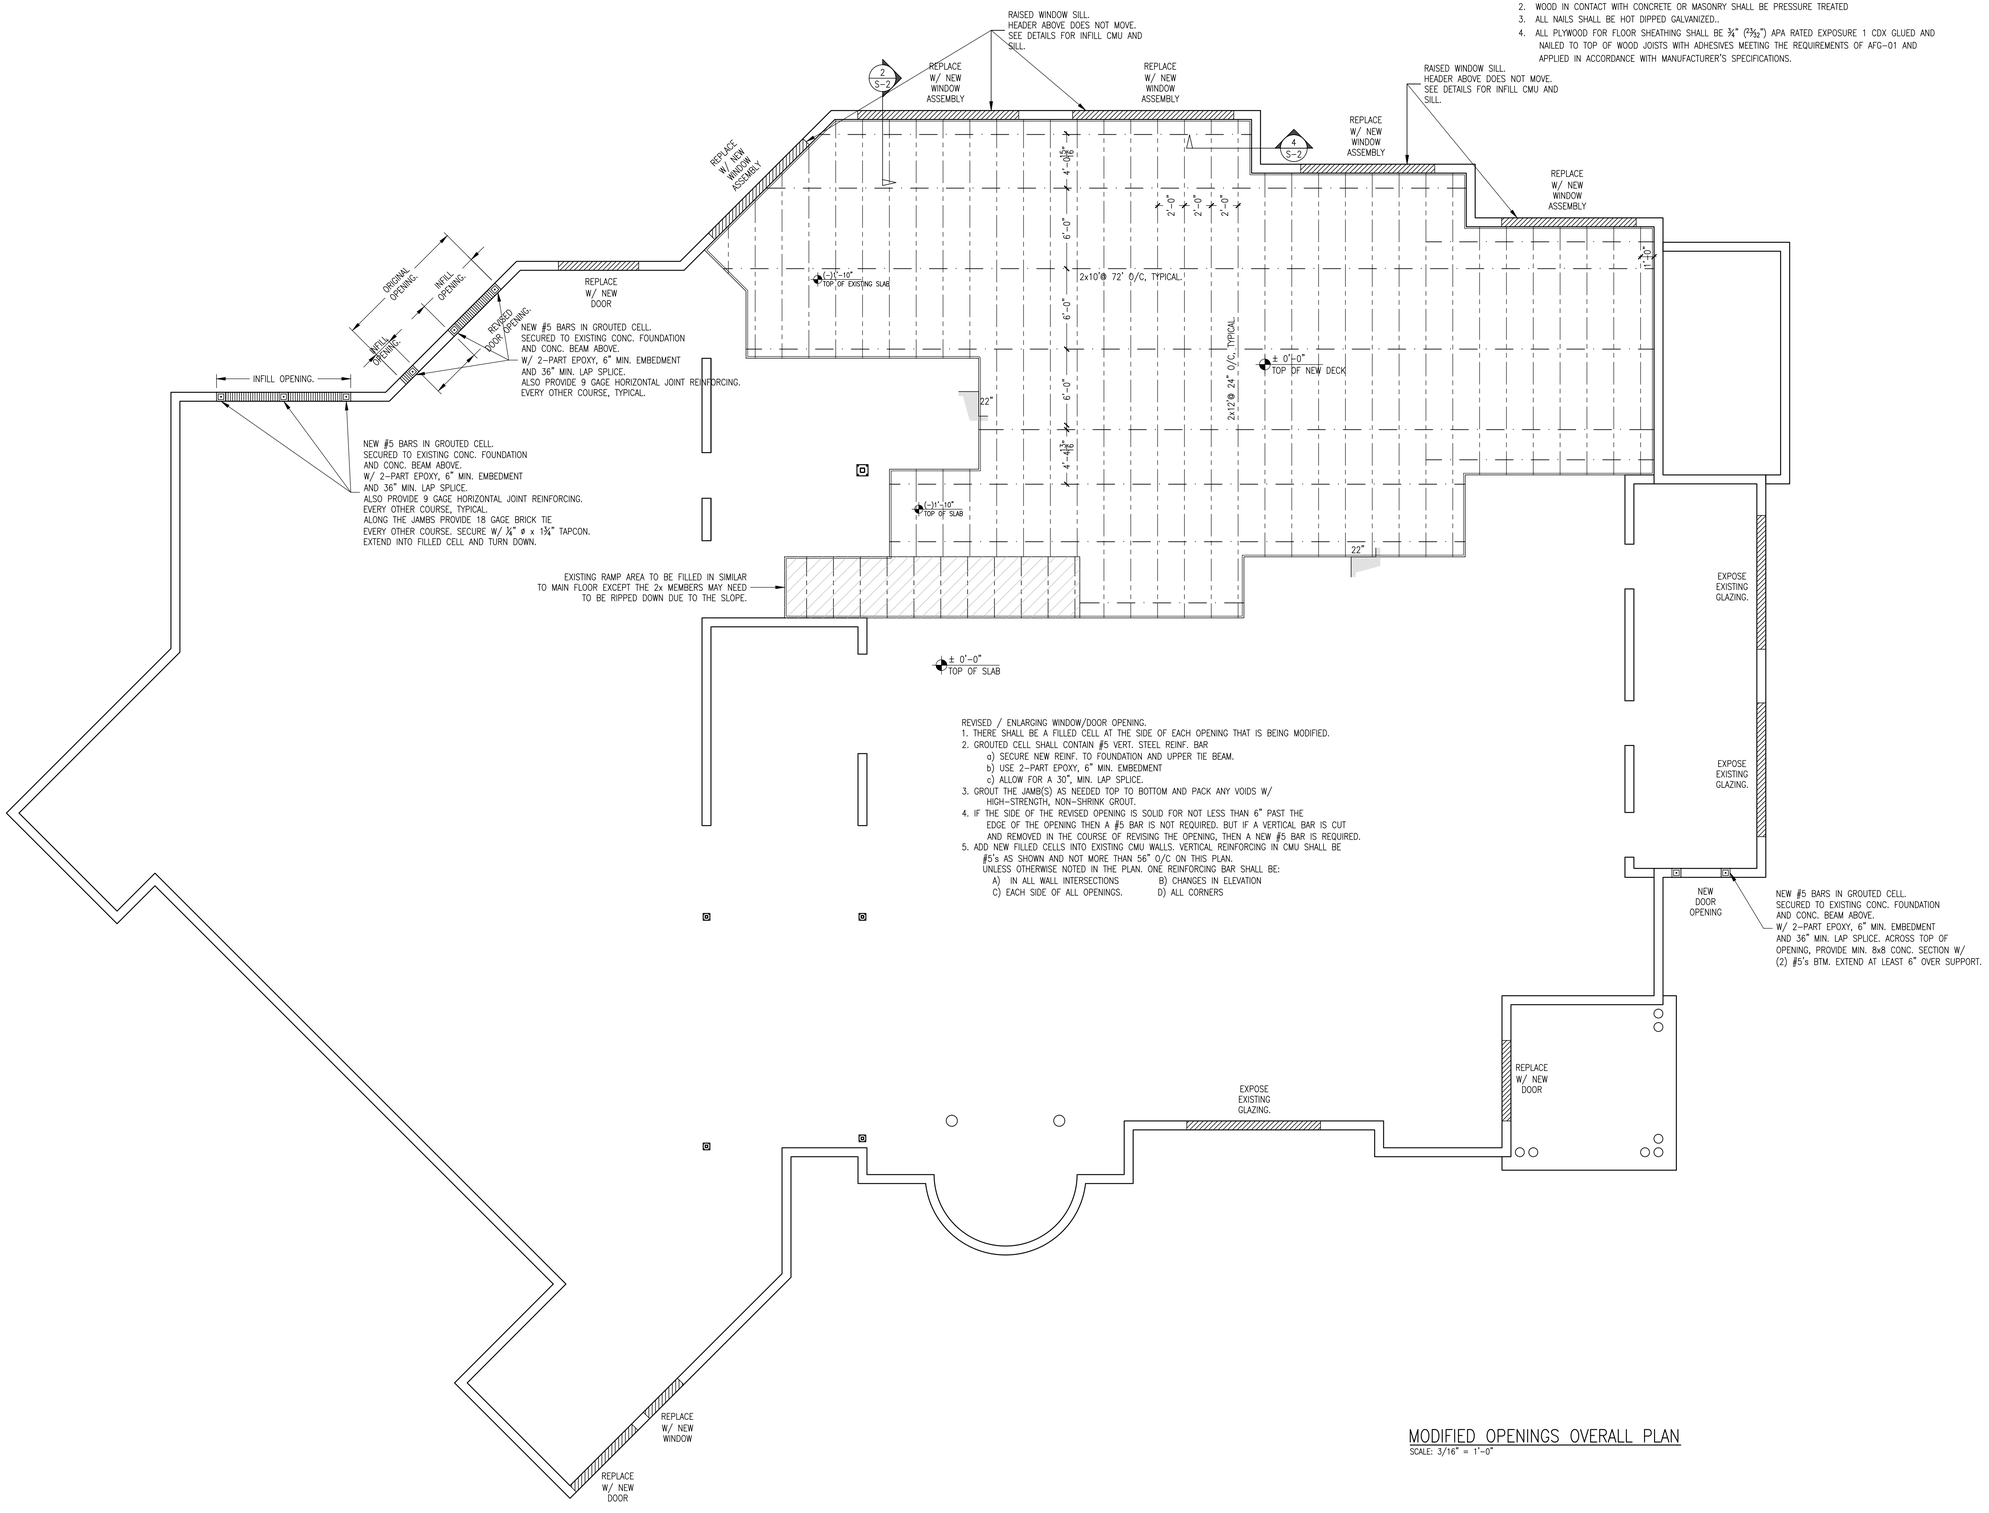

REVISED / ENLARGING WINDOW/DOOR OPENING.
1. THERE SHALL BE A FILLED CELL AT THE SIDE OF EACH OPENING THAT IS BEING MODIFIED.
2. GROUTED CELL SHALL CONTAIN #5 VERT. STEEL REINF. BAR
   a) SECURE NEW REINF. TO FOUNDATION AND UPPER TIE BEAM.
   b) USE 2-PART EPOXY, 6" MIN. EMBEDMENT
   c) ALLOW FOR A 30", MIN. LAP SPLICE.
3. GROUT THE JAMB(S) AS NEEDED TOP TO BOTTOM AND PACK ANY VOIDS W/ HIGH-STRENGTH, NON-SHRINK GROUT.
4. IF THE SIDE OF THE REVISED OPENING IS SOLID FOR NOT LESS THAN 6" PAST THE EDGE OF THE OPENING THEN A #5 BAR IS NOT REQUIRED. BUT IF A VERTICAL BAR IS CUT AND REMOVED IN THE COURSE OF REVISING THE OPENING, THEN A NEW #5 BAR IS REQUIRED.
5. ADD NEW FILLED CELLS INTO EXISTING CMU WALLS. VERTICAL REINFORCING IN CMU SHALL BE #5's AS SHOWN AND NOT MORE THAN 56" O/C ON THIS PLAN. UNLESS OTHERWISE NOTED IN THE PLAN. ONE REINFORCING BAR SHALL BE:
   A) IN ALL WALL INTERSECTIONS B) CHANGES IN ELEVATION
   C) EACH SIDE OF ALL OPENINGS. D) ALL CORNERS

MODIFIED OPENINGS OVERALL PLAN

SCALE: 3/16" = 1'-0"

The use of these specifications and plans shall be restricted to the original client and site for which they were prepared. Any reproduction or distribution is expressly limited to such use. Any other reproduction, reuse, or disclosure by any method, in whole or in part, is prohibited. These drawings and specifications contain proprietary information and title remains with

Specialty Engineering Consultants, Inc.

SHEET INFORMATION
FLOOR INFILL PLAN

PROJECT INFORMATION
KLA CHILDCARE
1601 N. CONGRESS AVE
BOYNTON BEACH, FL

CLIENT INFORMATION
MARK WEINER AIA
851 S FEDERAL HWY
SUITE 203
BOCA RATON, FL

SPECIALTY ENGINEERING CONSULTANTS, Inc

1599 SW 30th AVE.
SUITE #20
BOYNTON BEACH, FL 33426

DADE - BROWARD - PALM BEACH
FL. CA. #009217

561 - 752 - 5440 OFFICE
561 - 752 - 5542 FAX

FILE NAME.	struct_KLA_MWeiner
SCALE	3/16"=1'-0"
DATE	4/27/16
RV'D. BY	G.McD.
DRWN. BY	G.McD.
REVISION	0

SEAL
GARY McDOUGLE, PE FL #56214
D. MARK LeBLANC, PE FL #35683
D. ADAM LeBLANC, PE FL #77012

SHEET # S3 OF 3