LINE LEGEND

COLD WATER	NONPOTABLE WATER	EXISTING WASTE	GAS
HOT WATER 110°F	FILTERED WATER	GREASY WASTE	RAIN WATER LEADER
HOT WATER 140°F	BEER/SODA LINES	EXISTING GREASY WASTE	CONDENSATE
HOT WATER RECIRC	WASTE	VENT	DEMO

ABBREVIATIONS

BTU	BRITISH THREMAL UNIT	FS	FLOOR SINK	MBTU	THOUSAND BRITISH THREMAL UNIT
CD	CONDENSATE	FFD	FUNNEL DRAIN	ORD	OVERFLOW ROOF DRAIN
CO	WALL CLEAN OUT	HD	HUB DRAIN	PE	POLYETHYLENE PLASTIC PIPE
CW	COLD WATER	HB	HOSE BIBB	PR	PRESSURE/MP REGULATOR
FU	FIXTURE UNITS	HW	HOT WATER	RD	ROOF DRAIN
FCO	FLUSH CLEAN OUT	HWR	HOT WATER RECIRC	RWL	RAIN WATER LEADER
FD	FLOOR DRAIN	IM	ICE MACHINE	SCH 40	SCHEDULE 40 METALLIC PIPE
				SOV	SHUT-OFF VALVE
				TP	TRAP PRIMER
				VTR	VENT THRU ROOF
				VIF	VERIFY IN FIELD

FPC 2014 TABLE 704.1 SLOPE OF HORIZONTAL DRAINAGE PIPE	
SIZE (INCHES)	MINIMUM SLOPE (INCH PER FOOT)
2-1/2" OR LESS	1/4
3 TO 6"	1/8
8 OR LARGER	1/16

FPC 2014, 704.1: HORIZONTAL DRAINAGE PIPING SHALL BE INSTALLED IN UNIFORM ALIGNMENT AT UNIFORM SLOPES. THE MINIMUM SLOPE OF A HORIZONTAL DRAINAGE PIPE SHALL BE IN ACCORDANCE WITH TABLE 704.1.

NOTES

- ALL EXISTING PLUMBING FIXTURES ARE SUPPLIED WITH COLD WATER AND WHERE APPLICABLE HOT WATER.
- NEW SINK: AMERICAN STANDARD LUCERNE 0356.421, 20"X18", VITREOUS CHINA, FRONT OVERFLOW, CONCEALED ARMS, 4801.862 AMARILIS HERITAGE FAUCET WITH TRIUNE CROSS HANDLES. MCGUIRE 8887Z BRASS P-TRAP, 152N STRAINER WITH TAILPIECE, AND 2165CC SUPPLIES AND STOPS. HANDYSHIELD SAFETY COVERS ON ALL EXPOSED DRAINS AND SUPPLIES. WATTS WCA-411-US CARRIER WITH CONCEALED ARMS.

KEYED NOTES

1 REMOVE EXISTING WATER LINE AND CAP ABOVE FINISHED SERVICES.

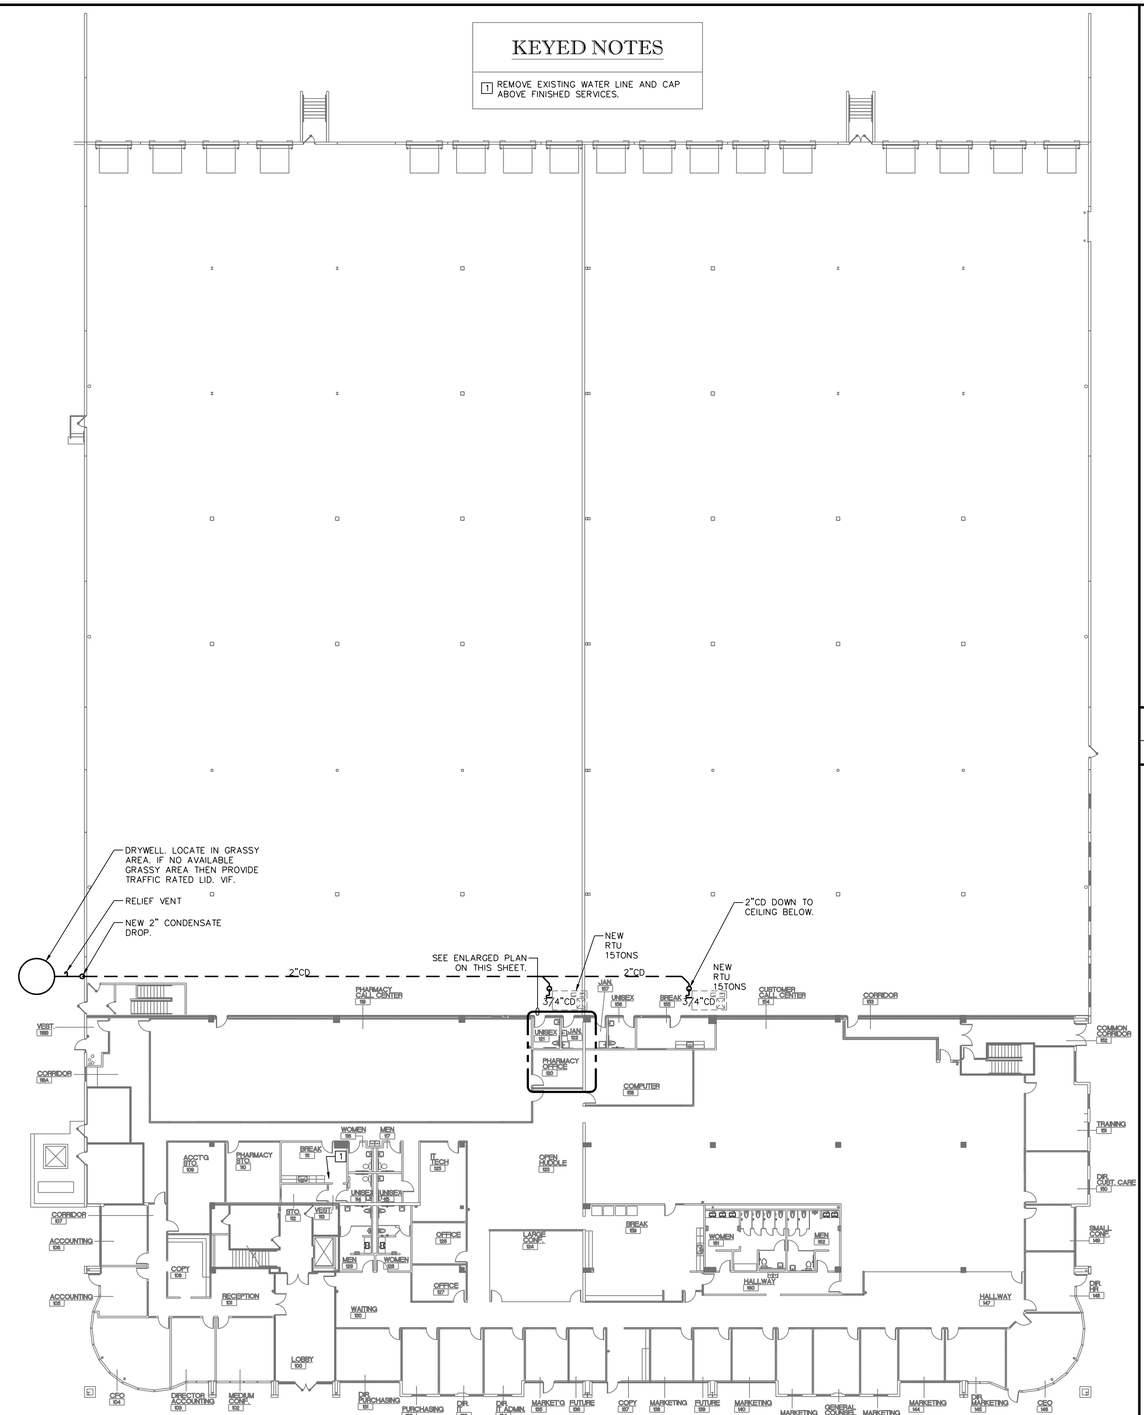

P1.1 PLUMBING PLAN — 1"=20'

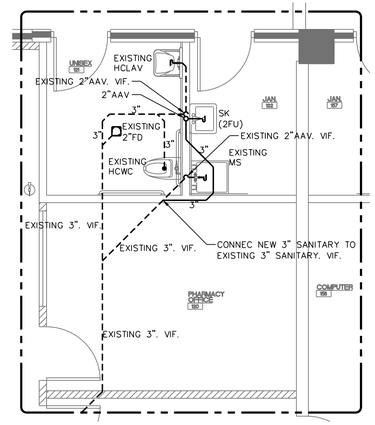

P1.2 PLUMBING ENLARGED SANITARY PLAN — 1/4" = 1'-0"

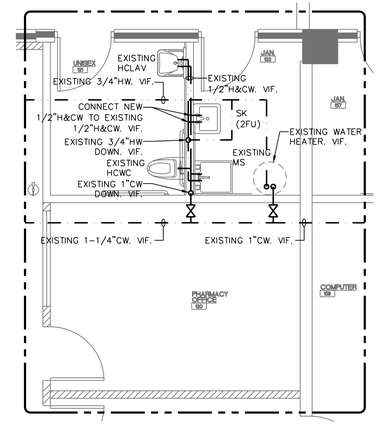

P1.3 PLUMBING ENLARGED WATER PLAN — 1/4" = 1'-0"

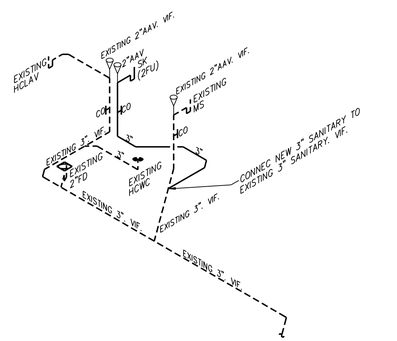

PLUMBING SANITARY RISER DIAGRAM

SCALE: N.T.S.

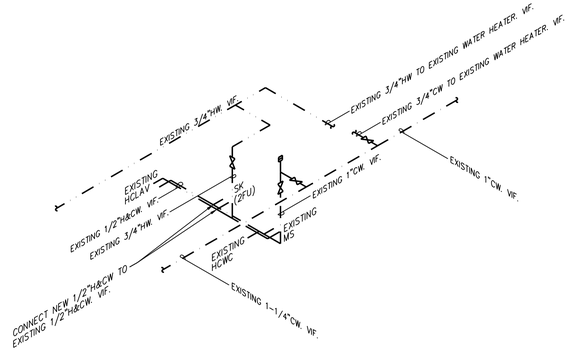

PLUMBING WATER RISER DIAGRAM

SCALE: N.T.S.

P1.4 PLUMBING RISER DIAGRAMS — N.T.S.

REVISION

©TRIESCHMANN DUMALA ARCHITECTURAL GROUP, 2015.
THIS DOCUMENT IS THE PROPERTY OF TRIESCHMANN DUMALA ARCHITECTURAL GROUP AND SHALL NOT BE REPRODUCED WITHOUT THE WRITTEN CONSENT OF TRIESCHMANN DUMALA ARCHITECTURAL GROUP

PETMEDS
420 SOUTH CONGRESS AVE. SUITE 100
DELRAY BEACH, FL
PLUMBING PLAN

TRIESCHMANN DUMALA architectural group
6451 East Rogers Circle ▮ Suite 9 ▮ Boca Raton ▮ FL 33487
P: 561.981.8000 F: 561.981.8916
AA26002244 AA26002252 www.tdarchgroup.com

Seal

Michael W. Dumala, AIA
Florida License No. AR 91003

Drawn

Date

P1.1

JOB # 1690

loucks engineering inc.
consulting engineers
E. PILKU P.E. FL REG 49832
4520 ne. 18th ave. ste. 400, ftlauderdale, fl. 33334
TEL. (954) 938-1881 FLA. REG. #EB-0003306