

ELECTRICAL GENERAL NOTES:

1. THE ELECTRICAL CONTRACTOR SHALL THOROUGHLY FAMILIARIZE HIMSELF WITH THE DRAWINGS, WHERE A DISCREPANCY OR CONFLICT IS FOUND BETWEEN ONE DRAWING AND ANOTHER THE CONTRACTOR SHALL NOTIFY THE A/E IMMEDIATELY IN WRITTEN FORM. CONTRACTOR SHALL NOT PROCEED WITH THAT PORTION OF THE WORK UNTIL A WRITTEN DIRECTIVE HAS BEEN RETURNED. IN GENERAL, THE MOST STRINGENT REQUIREMENT SHALL GOVERN UNLESS THE DISCREPANCY CONFLICTS WITH APPLICABLE CODES, WHEREIN THE CODE SHALL GOVERN.
2. THE DRAWINGS ARE DIAGRAMMATIC AND ARE NOT INTENDED TO SHOW EVERY DETAIL OF CONSTRUCTION, METHODS, MATERIALS AND EQUIPMENT, OR EXACT LOCATIONS, ROUTING, ETC. THEY INDICATE THE RESULT TO BE ACHIEVED BY THE ASSEMBLAGE OF SEVERAL SYSTEMS FOR A COMPLETE AND OPERATIONAL ELECTRICAL SYSTEM. DO NOT SCALE THE CONTRACT DOCUMENTS. COORDINATE EXACT EQUIPMENT LOCATIONS WITH THE ARCHITECTURAL PORTIONS OF THE CONTRACT DOCUMENTS, AS WELL AS FIELD CONDITIONS, APPROVED SHOP DRAWINGS, AND WORK OF ALL OTHER DIVISIONS/TRADES.
3. THE TERM "PROVIDE" USED IN THE CONTRACT DOCUMENTS INDICATES THAT THE CONTRACTOR SHALL FURNISH AND INSTALL MATERIALS, INCLUDING ALL COST FOR SHIPPING, UNLOADING, STORAGE, UNPACKING, ERECTION, ANCHORING, ETC. REQUIRED FOR CORRECT INSTALLATION OF A COMPLETE SYSTEM, UNLESS SPECIFICALLY NOTED OTHERWISE.
4. UNLESS NOTED AS EXISTING, ALL ELECTRICAL INDICATED IN THE CONTRACT DOCUMENTS SHALL BE NEW. EQUIPMENT SHALL BE INSTALLED AND USED IN ACCORDANCE WITH ANY INSTRUCTIONS INCLUDED IN THE LISTING OR LABELING.
5. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE 2011 EDITION OF THE NATIONAL ELECTRICAL CODE (NEC), ALL APPLICABLE LOCAL CODES, ORDINANCES AND ALL REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION (AHJ), AS A MINIMUM.
6. THE CONTRACTOR SHALL CARRY ALL INSURANCE REQUIRED TO PROTECT AGAINST PUBLIC LIABILITY AND PROPERTY DAMAGE FOR THE DURATION OF THIS PROJECT.
7. THE CONTRACTOR SHALL GUARANTEE ALL MATERIALS AND WORKMANSHIP ARE FREE FROM DEFECTS FOR A PERIOD OF NOT LESS THAN ONE YEAR FROM THE DATE OF FINAL ACCEPTANCE BY THE A/E AND OWNER. THE CONTRACTOR, AT NO ADDITIONAL COSTS, SHALL PROVIDE THE CORRECTION OF ANY DEFECTS INCLUDING REPAIR OR REPLACEMENT.
8. THE CONTRACTOR SHALL VISIT AND CAREFULLY EXAMINE THOSE PORTIONS OF THE BUILDING AND/OR SITE AFFECTED BY THIS WORK PRIOR TO SUBMITTING PROPOSALS, SO AS TO BECOME FAMILIAR WITH EXISTING CONDITIONS AND DIFFICULTIES THAT MAY AFFECT EXECUTION OF THE WORK. SUBMISSION OF A PROPOSAL WILL BE CONSTRUED AS EVIDENCE THAT SUCH EXAMINATION HAS BEEN MADE. LATER CLAIMS FOR LABOR, EQUIPMENT AND/OR MATERIALS REQUIRED DUE TO DIFFICULTIES ENCOUNTERED THAT COULD HAVE REASONABLY BEEN OBSERVED BY THE CONTRACTOR WILL NOT BE RECOGNIZED.
9. THE CONTRACTOR SHALL COORDINATE ALL PROJECT SCHEDULING REQUIREMENTS WITH A/E AND OWNER PRIOR TO SUBMITTING PROPOSAL. THIS PROJECT MAY REQUIRE PHASING SEQUENCES AND POTENTIAL PREMIUM TIME WORK AND ALL COSTS FOR SUCH SHALL BE INCLUDED IN THE CONTRACTOR'S PROPOSAL. THE CONTRACTOR SHALL PROVIDE ADEQUATE WORK FORCE, EQUIPMENT, AND SHALL WORK SUCH HOURS INCLUDING PREMIUM TIME AS MAY BE REQUIRED IN ORDER TO ADHERE TO THE PROJECT SCHEDULE. ADDITIONALLY, THE CONTRACTOR SHALL ENSURE THAT LONG-LEAD ITEMS DO NOT IMPACT THE PROJECT'S SCHEDULE OR PHASING.
10. ALL TEMPORARY DOWNTIME REQUIRED FOR SYSTEM TIE-IN OR SWITCHOVER FOR ANY PORTION OF THE ELECTRICAL SYSTEM SHALL BE PRE-APPROVED BY THE OWNER AND SCHEDULED IN ADVANCE.
11. IF HAZARDOUS MATERIALS ARE ENCOUNTERED, THE CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE RULES, REGULATIONS AND GUIDELINES CONCERNING REMOVAL, HANDLING, DISPOSAL, AND PROTECTION AGAINST ENVIRONMENTAL EXPOSURE OR POLLUTION. CONTRACTOR SHALL PROVIDE DOCUMENTATION OF SAID COMPLIANCE.
12. CONDUCT WORK OPERATIONS AND DEBRIS REMOVAL IN A MANNER THAT ENSURES MINIMUM INTERFERENCE WITH NORMAL BUSINESS OPERATIONS, TRAFFIC, PARKING, ETC. ONGOING IN ADJACENT OCCUPIED SPACES OR FACILITIES. PROVIDE ALL THAT IS REQUIRED TO EFFECTIVELY PROTECT SURROUNDING OCCUPANTS, EQUIPMENT, FINISHES, FURNITURE, ETC. FROM DAMAGE OR EXCESSIVE NOISE THROUGHOUT THE DURATION OF THIS PROJECT. ANY DAMAGE TO SURROUNDING ELEMENTS RESULTING FROM THE CONTRACTOR'S FAILURE TO ADHERE TO THIS REQUIREMENT SHALL BE RESTORED TO ORIGINAL CONDITION BY THE CONTRACTOR, TO THE SATISFACTION OF THE A/E AND OWNER, AT NO ADDITIONAL COSTS. REPORT ANY SUCH OCCURRENCE TO THE A/E AND OWNER IMMEDIATELY AND AWAIT WRITTEN DIRECTION PRIOR TO PROCEEDING WITH REPAIRS.
13. CONTRACTOR SHALL MAINTAIN A CURRENT ACCURATE SET OF PROJECT RECORD DOCUMENTS (AS-BUILTS) AT THE SITE THROUGHOUT THE DURATION OF THIS PROJECT. RECORD DRAWINGS SHALL BE UPDATED EACH DAY TO REFLECT THE ACTUAL LOCATIONS, SIZES, ROUTING, ETC. OF EACH PORTION OF THE ELECTRICAL SYSTEM AFFECTED BY THIS WORK. A FINAL SET OF RECORD DOCUMENTS SHALL BE ISSUED TO THE A/E FOR REVIEW AND THEN SUBMITTED TO THE OWNER AT THE CONCLUSION OF THE PROJECT.
14. ALL 120V, 20A BRANCH CIRCUITS OVER 80'-0" IN LENGTH SHALL BE #10 AWG CU. CONDUCTORS, CIRCUITS OVER 150'-0" IN LENGTH SHALL BE #8 AWG CU CONDUCTORS MINIMUM TO ACCOMMODATE VOLTAGE DROP. WHERE A CONFLICT EXISTS BETWEEN THIS REQUIREMENT AND CONDUCTOR SIZES INDICATED ELSEWHERE IN THE CONTRACT DOCUMENTS, THIS REQUIREMENT SHALL TAKE PRECEDENCE.
15. IN GENERAL, VOLTAGE DROP FOR ANY BRANCH CIRCUIT SHALL NOT EXCEED 3%. VOLTAGE DROP FOR ANY FEEDER SHALL NOT EXCEED 2%. WHERE VOLTAGE DROP EXCEEDS THESE REQUIREMENTS, THE CONTRACTOR SHALL INCREASE THE SIZE OF THE CONDUCTORS AND RACEWAY AS REQUIRED.
16. CONTRACTOR SHALL PROVIDE ALL PENETRATIONS THROUGH FLOORS, WALLS, CEILINGS AND ROOFS. COORDINATE LOCATIONS AND SIZES WITH THE ARCHITECTURAL AND STRUCTURAL PORTIONS OF THE CONTRACT DOCUMENTS, FIELD CONDITIONS, AND WORK OF ALL OTHER DIVISIONS/TRADES. ALL OPENINGS SHALL BE SEALED WATERTIGHT.
17. WHERE OPENINGS PENETRATE A FIRE RATED FLOOR, WALL, CEILING, OR ROOF, FIRESTOPPING SHALL BE PROVIDED. MEET ALL REQUIREMENTS FOR THE U.L. ASSEMBLY AND RACEWAYS INVOLVED.
18. ALL COMPONENTS OF THE ELECTRICAL SYSTEM LOCATED OUTDOORS OR INDOORS WHERE EXPOSED TO SIGNIFICANT MOISTURE SHALL BE RAINPROOF TYPE NEMA 3R (MINIMUM), WHETHER INDICATED ON CONTRACT DOCUMENTS OR NOT.
19. ALL WORK ON THE ELECTRICAL SYSTEM REQUIRED BY THE CONTRACT DOCUMENTS SHALL BE COORDINATED WITH THE WORK OF ALL OTHER DIVISIONS/TRADES PRIOR TO THE COMMENCEMENT OF WORK. AVOID INTERFERENCES WITH THE PROGRESS OF OTHER DIVISIONS/TRADES. CONTRACTOR SHALL PROVIDE COORDINATION DRAWINGS TO INCLUDE HVAC, POWER, LIGHTING AND SPECIAL SYSTEMS COMPONENTS PRIOR TO INSTALLATION, FAILURE TO COMPLY WITH THIS REQUEST MAY RESULT IN DIRECTIVE TO REMOVE SUCH SYSTEM DEVICE.
20. COORDINATE THE EXACT LOCATIONS OF ALL DEVICES (RECEPTACLES, TELECOMMUNICATIONS OUTLETS, FIRE ALARM, SECURITY, ETC.) WITH THE ARCHITECTURAL PLANS, FURNITURE SYSTEMS PLAN, OWNERS REPRESENTATIVE, APPROVED MILLWORK SHOP DRAWINGS, AND FIELD CONDITIONS PRIOR TO ROUGH-IN.
21. COORDINATE THE EXACT REQUIREMENTS OF ALL MECHANICAL EQUIPMENT PRIOR TO PREPARING SUBMITTALS (PRODUCT DATA & SHOP DRAWINGS). THE CONTRACTOR SHALL PROVIDE ALL RACEWAYS, CONDUCTORS, BOXES, EQUIPMENT, DISCONNECT SWITCHES, CIRCUIT BREAKERS, CONTROL CIRCUITS, CONTROL TRANSFORMERS, FIRE ALARM SHUTDOWN, ETC. REQUIRED FOR A COMPLETE AND OPERATIONAL SYSTEM. VERIFY EXACT LOCATION OF ALL MECHANICAL EQUIPMENT PRIOR TO COMMENCEMENT OF WORK.
22. THE USE OF ALUMINUM CONDUCTORS, RACEWAYS, BOXES, BUSSING, WINDINGS, ETC. ARE PROHIBITED UNLESS SPECIFICALLY NOTED OTHERWISE.
23. ALL FEEDER AND BRANCH CIRCUIT CONDUCTORS, INCLUDING LOW VOLTAGE SYSTEMS, SHALL BE INSTALLED IN A COMPLETE RACEWAY SYSTEM UNLESS SPECIFICALLY NOTED OTHERWISE.
24. ALL BRANCH CIRCUITS SHALL BE INSTALLED IN 1/2" TRADE SIZE RACEWAY MINIMUM, INCLUDING FLEXIBLE METAL CONDUIT AND LIQUIDTIGHT FLEXIBLE METAL CONDUIT (FMC & LFMC).
25. FLEXIBLE METAL CONDUIT AND LIQUIDTIGHT FLEXIBLE METAL CONDUIT (FMC & LFMC) SHALL NOT BE USED IN LENGTHS THAT EXCEED 6'-0" UNLESS SPECIFICALLY NOTED OTHERWISE, OR UNLESS A/E AND OWNER GRANTS WRITTEN PERMISSION.
26. PROVIDE TYPED PANEL DIRECTORIES FOR ALL PANELBOARDS.
27. ALL DEVICE OUTLET BOXES, JUNCTION BOXES, PULL BOXES, AND RACEWAYS SHALL BE CONCEALED IN CEILINGS, WALLS OR BELOW SLAB UNLESS SPECIFICALLY NOTED OTHERWISE, OR UNLESS A/E AND OWNER GRANTS WRITTEN PERMISSION.
28. ALL LIGHTING FIXTURES SHALL BE PROVIDED COMPLETE WITH LAMPS.
29. PROVIDE WET LOCATION LISTED FUSING AT EACH EXTERIOR LIGHTING FIXTURE THAT CONTAINS BALLASTS.
30. NEW HEATING, VENTILATION AND AIR CONDITIONING EQUIPMENT SHALL BE PROTECTED WITH HACR RATED CIRCUIT BREAKERS OR FUSES.
31. ALL WIRING DEVICES WILL BE BACKWIRED.
32. ALL CONDUCTORS SHALL BE STRANDED.
33. FOR EXACT LOCATION OF NEW LIGHT FIXTURES REFER TO THE ARCHITECTURAL REFLECTED CEILING PLAN.
34. CONTRACTOR SHALL COORDINATE LIGHT FIXTURE INSTALLATION WITH EXISTING CEILING CONDITIONS AND PROVIDE NECESSARY HARDWARE, OR ADJUST FIXTURE MODEL NUMBER TO INCLUDE PROPER MOUNTING OPTIONS.

ELECTRICAL GENERAL NOTES: (CONT.)

35. CONTRACTOR SHALL PROVIDE AN UNSWITCHED CIRCUIT TO NEW EXIT SIGN AND WALL MOUNTED EMERGENCY LIGHT FIXTURES. CIRCUIT SHALL BE SAME AS THAT OF THE NORMAL LIGHTING CIRCUIT FOR THE ROOM.
36. ALL EMERGENCY LIGHT FIXTURES AND EXIT SIGNS SHALL HAVE AN INTEGRAL BATTERY THAT WILL PROVIDE A MINIMUM OF 90 MINUTES OF EMERGENCY OPERATION.
37. NEW LIGHT FIXTURES SHALL BE LISTED AND SUITABLE FOR THE SPECIFIC APPLICATION AND SHALL BEAR LABEL STATING SUCH.
38. THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR REVIEW AND ACCEPTANCE FOR ALL DEVICES, FIXTURES AND MATERIALS USED PRIOR TO ORDERING.
39. CONTRACTOR SHALL GUARANTEE ALL MATERIALS AND WORKMANSHIP FREE OF DEFECTS FOR A PERIOD OF ONE YEAR AFTER ACCEPTANCE.
40. PROVIDE FIELD MARKINGS WARNING PERSONNEL OF POTENTIAL ARC FLASH HAZARDS IN ACCORDANCE WITH NEC 110.

ELECTRICAL DEMOLITION NOTES:

1. CONTRACTOR SHALL VISIT THE SITE AND FAMILIARIZE HIMSELF WITH THE EXISTING CONDITIONS PRIOR TO COMMENCING ANY DEMOLITION EFFORT.
2. COORDINATE ALL WORK AND PHASING (DEMOLITION AND NEW) WITH ARCHITECTURAL AND OTHER M.E.P. CONTRACT DOCUMENTS. ALSO COORDINATE ALL WORK (DEMOLITION AND NEW) WITH ALL CONTRACTORS.
3. COMPLETELY REMOVE ALL ELECTRICAL COMPONENTS INCLUDING, BUT NOT LIMITED TO: WIRING, LIGHTING FIXTURES, SWITCHES, RECEPTACLES, EXHAUST FANS, ALARM DEVICES, SPEAKERS, J-BOXES, SAFETY SWITCHES, PANELBOARDS.
4. CONDUIT & RACEWAY MAY BE REUSED IF IN GOOD CONDITION AND MEETS N.E.C. AND SPECIFICATION REQUIREMENTS OF THIS PROJECT. IF NOT, THEY SHALL BE COMPLETELY REMOVED.
5. REMOVE SERVICE PANELS, METERS, C.T. ENCLOSURES, RISERS, SAFETY SWITCHES, ETC. COORDINATE ALL WORK (DEMOLITION AND NEW) WITH UTILITY.

ELECTRICAL LIGHTING LEGEND

	2'x4" RECESSED LIGHT FIXTURE.
	2'x2" RECESSED LIGHT FIXTURE.
	RECESSED DOWNLIGHT.
	EMERGENCY BATTERY BACKUP FIXTURE
	20 AMP, 120/277 VOLT SINGLE POLE TOGGLE SWITCH MOUNTED 48" AFF, UNLESS OTHERWISE NOTED. (D = DIMMER SWITCH)
	DUAL TECHNOLOGY WALL MOUNTED VACANCY SENSOR SWITCH WITH OVERRIDE
	3-WAY SWITCH
	DUAL TECHNOLOGY CEILING MOUNTED OCCUPANCY SENSOR SWITCH WITH OVERRIDE.
	2000 WATT, 120 OR 277 VOLT PHOTOCELL WITH LIGHT LEVEL SELECTOR AND WALL MOUNTING BRACKET. MOUNT AS HIGH AS POSSIBLE, FACING NORTH.
	40 AMP, 120 OR 277 VOLT, 24-HOUR, 7-DAY, DIGITAL DPDT TIME CLOCK WITH 16-HOUR CARRYOVER MINIMUM IN A NEMA 1 ENCLOSURE (NEMA 3R FOR OUTDOOR LOCATIONS).
	30 AMP 120 OR 277 VOLT ELECTRICALLY HELD MULTIPOLE LIGHTING CONTACTOR IN A NEMA 1 ENCLOSURE (NEMA 3R FOR OUTDOOR LOCATIONS). PROVIDE NUMBER OF POLES AS REQUIRED FOR NUMBER OF CIRCUITS CONTROLLED, PLUS 2 SPARES MINIMUM. CONTACTOR LABELING "C1, C2 & C3" TYPICAL FOR MULTIPLE CONTACTORS.

ELECTRICAL SYSTEMS LEGEND

	CEILING MOUNTED ADDRESSABLE COMBINATION FIXED TEMPERATURE AND RATE OF RISE HEAT DETECTOR.
	CEILING MOUNTED ADDRESSABLE SMOKE DETECTOR.
	SINGLE ACTION MANUAL PULL STATION MOUNTED 48" AFF, UNLESS OTHERWISE NOTED.
	FIRE ALARM SPEAKER AND VISUAL UNIT MOUNTED AT 80" AFF, UNLESS OTHERWISE NOTED. "X" INDICATES CANDELA INTENSITY.
	FIRE ALARM VISUAL UNIT ONLY MOUNTED AT 80" AFF, UNLESS OTHERWISE NOTED. "X" INDICATES CANDELA INTENSITY.
	FIRE ALARM ANNUCIATOR PANEL.
	FIRE ALARM CONTROL PANEL.
	VACANCY LIGHT SWITCH
	VACANCY SENSOR
	COMBINATION EXIT AND EMERGENCY LIGHT FIXTURE

NOTE:
NOT ALL SYMBOLS ARE USED.

COORDINATION NOTE:

EACH CONTRACTOR AND SUBCONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING THE INSTALLATION OF HIS EQUIPMENT AND WORK WITH THE GENERAL CONTRACTOR AND WORK OF ALL OTHER CONTRACTORS, SUB CONTRACTORS AND TRADES. ANY AND ALL EQUIPMENT, FIXTURES AND/OR MATERIAL REMOVED AND/OR INSTALLED WITHOUT THE PROPER COORDINATION SHALL BE REMOVED AND/OR REINSTALLED AT NO ADDITIONAL EXPENSE TO THE OWNER.

AS BUILT NOTE:

AS-BUILT CONDITIONS MAY NOT COINCIDE WITH THOSE INDICATED ON THE CONSTRUCTION DOCUMENTS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR DEMOLITION, BUT NOT LIMITED TO, ALL THE ITEMS LISTED FOR DEMOLITION IN THE CONSTRUCTION DOCUMENTS. THE CONTRACTOR SHALL INSPECT THE EXISTING CONDITIONS AND SHALL BE RESPONSIBLE FOR DEMOLITION OF EXISTING WORK AS REQUIRED TO COMPLETE THE NEW WORK.

ELECTRICAL SHEET INDEX

E0.1	ELECTRICAL - LEGENDS, NOTES & SHEET INDEX
E1.1	ELECTRICAL FLOOR & ROOF POWER PLANS
E2.1	ELECTRICAL FLOOR LIGHTING PLAN
E3.1	ELECTRICAL RISER DIAGRAM & PANEL SCHEDULES

ELECTRICAL POWER LEGEND

	HOMERUN TO PANEL. "X" INDICATES PANEL, "Y" INDICATES CIRCUIT NUMBER(S).
	RECEPTACLE LABELING WHEN NOT SHOWING CONDUIT AND WIRE. "X" INDICATES PANEL, "Y" INDICATES CIRCUIT NUMBER(S), (TYPICAL FOR ALL POWER SYMBOLS). MOUNTING HEIGHT 18" A.F.F. TO Ⓢ.
	QUADRIPEX RECEPTACLE
	CEILING MOUNTED DROP CORD WITH DUPLEX RECEPTACLE (EX - INDICATES EXISTING TO REMAIN)
	RECEPTACLE, ABOVE THE COUNTER
	RECEPTACLE, WITH GROUND FAULT CIRCUIT INTERRUPTER
	SPECIAL PURPOSE RECEPTACLE - PROVIDE MATCHING PLUG AS REQUIRED.
	DATA AND TELEPHONE OUTLET MOUNTED 18" ABOVE FINISHED FLOOR UNLESS OTHERWISE X 2 1/2" BOX WITH SINGLE GANG PLASTER RING AND 1" C
	DENOTES ABOVE THE COUNTER. COORDINATE HEIGHT OF THE OUTLET WITH THE COUNTER OR MILLWORK BEFORE ROUGH-IN. REFER TO ARCHITECTURAL PLANS FOR COUNTER HEIGHTS
	JUNCTION BOX MOUNTED IN OR ABOVE CEILING.
	NONFUSED DISCONNECT SWITCH. XX=AMP SIZE, X=POLES AND ENCLOSURE AS INDICATED. "WP" INDICATES WEATHERPROOF NEMA 3R ENCLOSURE.
	FUSED DISCONNECT SWITCH. AMP SIZE, POLES, FUSING AND ENCLOSURE AS INDICATED. "WP" INDICATES WEATHERPROOF NEMA 3R ENCLOSURE.
	VARIABLE SPEED DRIVE UNIT.
	SURFACE MOUNTED POWER OR APPLIANCE PANELBOARD.
	FLUSH MOUNTED POWER OR APPLIANCE PANELBOARD.
	MOTOR OUTLET, "X" INDICATES ESTIMATED HORSEPOWER.
	TRANSFORMER.
	MOTOR RATED OCCUPANCY SENSOR, 120V

NOTE:
NOT ALL SYMBOLS ARE USED.

TO THE BEST OF MY KNOWLEDGE THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH THE 2014 FLORIDA BUILDING CODE, ALL AMENDMENTS AND SECTION 633 OF THE FLORIDA STATUTES.

ARCHITECTURE
RICK BRAUTIGAN
 1025 S Dixie Highway
 Delray Beach, FL 33483
 Ph: 561.272.9086
 Fx: 561.272.5636
 AAC002029


Beacon Consulting Engineers
 100 N.E. 8th St. Unit 102
 Boynton Beach, FL 33435
 561-424-3270
 Mechanical - Plumbing - Electrical - Fire Protection
 Consulting Engineering

Level II Alteration
Green Owl Restaurant
 11 SE 4th Ave.
 Delray Beach, Florida

R.B.A. PN. 10116.01

Issued Date:

Joeven M. Valenzuela P.E.
 Florida Reg. No. 60287

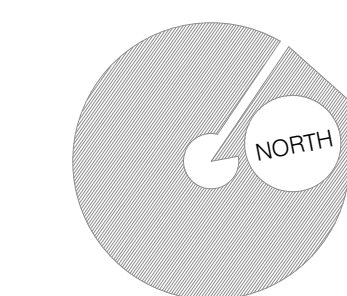

E
0.1

ELECTRICAL NOTES

AS NOTED

PROGRESS SET/NFC 03/04/2016

ALL DESIGNS, CONCEPTS AND IDEAS CONTAINED AND REPRESENTED HEREIN ARE THE PROPERTY OF RICK BRAUTIGAN ARCHITECTURE, INC. AND MAY NOT BE ALTERED, CHANGED, MODIFIED OR COPIED WITHOUT THE PERMISSION OF RICK BRAUTIGAN ARCHITECTURE, INC. EXPRESSED IN WRITING.
 1. DIMENSIONS ARE NOT TO BE SCALED. WRITTEN DIMENSIONS HAVE PRECEDENCE OVER ALL SCALED DIMENSIONS. 2. CONTRACTOR TO VERIFY ALL DIMENSIONS AND ADVISE ARCHITECT OF ANY DISCREPANCIES. CONSTRUCTION SHALL NOT PROCEED UNTIL SAID DISCREPANCIES HAVE BEEN RESOLVED.
 3. NO MATERIALS OR SYSTEMS ARE TO BE FABRICATED UNTIL ALL DIMENSIONS HAVE BEEN REVIEWED BY CONTRACTOR & SHOP DRAWINGS HAVE BEEN REVIEWED AND ACCEPTED BY THE ARCHITECT.