

- 4 PER FBC BUILDING 904.11.2. THE ACTUATION OF THE FIRE SUPPRESSION SYSTEM SHALL AUTOMATICALLY SHUT DOWN THE FUEL OR ELECTRICAL POWER SUPPLY TO THE COOKING EQUIPMENT. THE FUEL AND ELECTRICAL SUPPLY RESET SHALL BE MANUAL. ELECTRICAL CONTRACTOR TO SUPPLY SHUNT TRIP BREAKER AT PANEL LINKED WITH ANSUL SYSTEM.
- 5 ALL RECEPTACLES INSTALLED IN COOKING, PREPARATION AND KITCHEN AREAS SHALL BE "GFI" TYPE RECEPTACLES PER THE NATIONAL ELECTRICAL CODE.


GENERAL NOTES:

- 1. CONDUIT AND EQUIPMENT LOCATIONS ARE SHOWN FOR INFORMATION ONLY. VERIFY WITH ARCHITECT/OWNER FOR EXACT LOCATIONS PRIOR TO CONSTRUCTION.
- 2. ALL ELECTRICAL CONDUITS ARE TO BE RUN OVERHEAD, TYPICAL UNLESS OTHERWISE NOTED.

COORDINATION NOTE:

CONTRACTOR(S) SHALL VERIFY ALL TENANT STANDARDS AND PROCEDURES, FLOOR PLANS, LAYOUTS, EQUIPMENT MANUFACTURERS AND MODELS, LIGHTING, AND ALL INSTALLATIONS AND REQUIREMENTS PRIOR TO CONSTRUCTION. CONTRACTOR SHALL COORDINATE ALL OF THESE REQUIREMENTS AND ASSOCIATED INSTALLATIONS WITH TENANT, AND ARCHITECTURAL AND MEP CONTRACT DOCUMENTS.



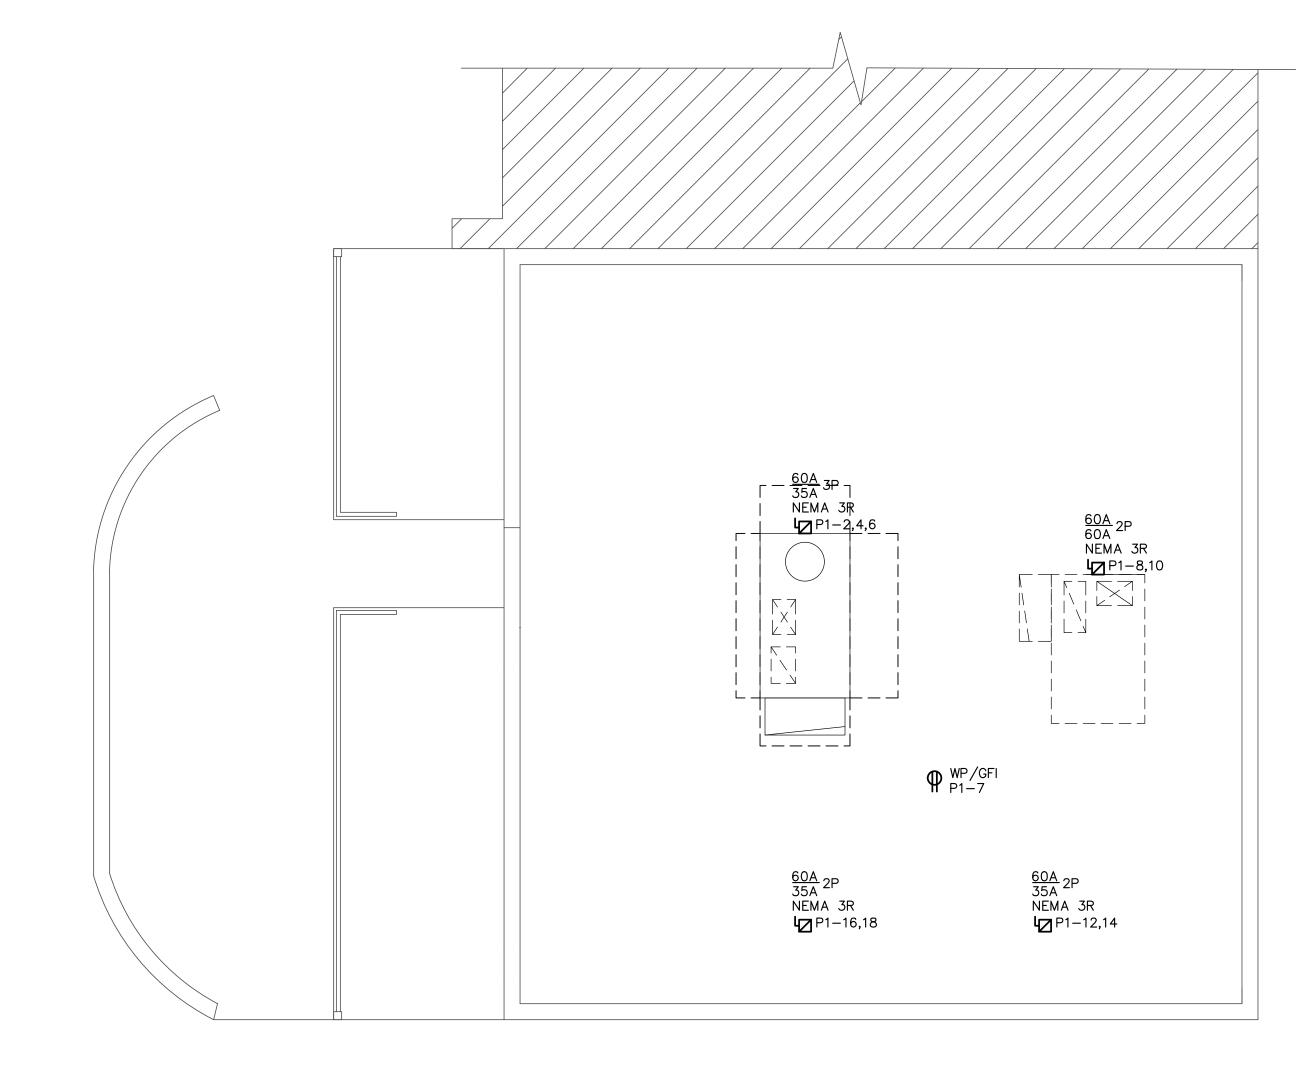

ELECTRICAL ROOF POWER PLAN

SCALE: 1/4" = 1'-0"

RBA. PN. 10116.01 Issued Date:

Level II Alteration

Green Owl

Restaurant

Joeven M. Valenzuela P.E.

_ Florida Reg. No. 60287_

11 SE 4th Ave.

Delray Beach,

Florida

TO THE BEST OF MY KNOWLEDGE THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH THE 2014 FLORIDA BUILDING CODE, ALL AMENDMENTS AND SECTION 633 OF THE FLORIDA STATUES.

AS NOTED

RickBrautigan

10258Dixie Highway

Ph: 561.272.9086 Fx: 561.272.5636

AAC002029

Delra y Beach, FL 33483

Beacon Consulting Engineers

100 N.E. 6th St. Unit 102
Boynton Beach, FL 33435

PROGRESS SET/NFC 03/04/2016

ELECTRICAL FLOOR POWER PLAN

SCALE: 14" = 1-0"

SHEET KEY NOTES:

(1) FOR DESCRIPTION OF ITEM NUMBERS SEE EQUIPMENT SCHEDULE ON THIS SHEET.

(2) PER NFPA 96 SECTION 8.3.2. WHEN FIRE EXTINGUISHING SYSTEM DISCHARGES, INTERLOCK AHU'S WITH ANSUL SYSTEM TO SHUT DOWN UPON ACTIVATION.

(3) THE COOKING EQUIPMENT UNDER THE HOOD IS TO BE INTERLOCKED WITH THE KITCHEN HOOD EXHAUST FAN SO THE KITCHEN EQUIPMENT CANNOT OPERATE UNILESS THE HOOD EXHAUST FAN SO THE KITCHEN EQUIPMENT CANNOT OPERATE UNILESS THE HOOD EXHAUST FAN SO THE KITCHEN EQUIPMENT CANNOT OPERATE UNILESS THE HOOD EXHAUST FAN SO THE KITCHEN EQUIPMENT CANNOT OPERATE UNILESS THE HOOD EXHAUST FAN SO THE KITCHEN EQUIPMENT CANNOT OPERATE UNILESS THE HOOD EXHAUST FAN SO THE KITCHEN EQUIPMENT CANNOT OPERATE UNILESS THE HOOD EXHAUST FAN IS OPERATING.

(4) PER FBC BUILDING 904.11.2. THE ACTUATION OF THE FIRE SUPPRESSION

ALL DESIGNS, CONCEPTS, AND IDEAS CONTAINED AND REPRESENTED HEREIN ARE THE PROPERTY OF RICK BRAUTIGAN ARCHITECTURE, INC. EXPRESSED IN WRITING.

1. DRAWINGS ARE NOT TO BE SCALED. WRITTEN DIMENSIONS HAVE PRECEDENCE OVER ALL SCALED DIMENSIONS. 2. CONTRACTOR TO VERIFY ALL DIMENSIONS AND ADVISE ARCHITECT OF ANY DISCREPANCIES. CONSTRUCTION SHALL NOT PROCEED UNTIL SAID DISCREPANCIES HAVE BEEN RESOLVED.

3. NO MATERIALS OR SYSTEMS ARE TO BE FABRICATED UNTIL: A) ALL DIMENSIONS HAVE BEEN VERIFIED BY CONTRACTOR B) SHOP DRAWINGS HAVE BEEN REVIEWED AND ACCEPTED BY THE ARCHITECT