




**PANELBOARD/EQUIPMENT NAMEPLATE**  
No Scale

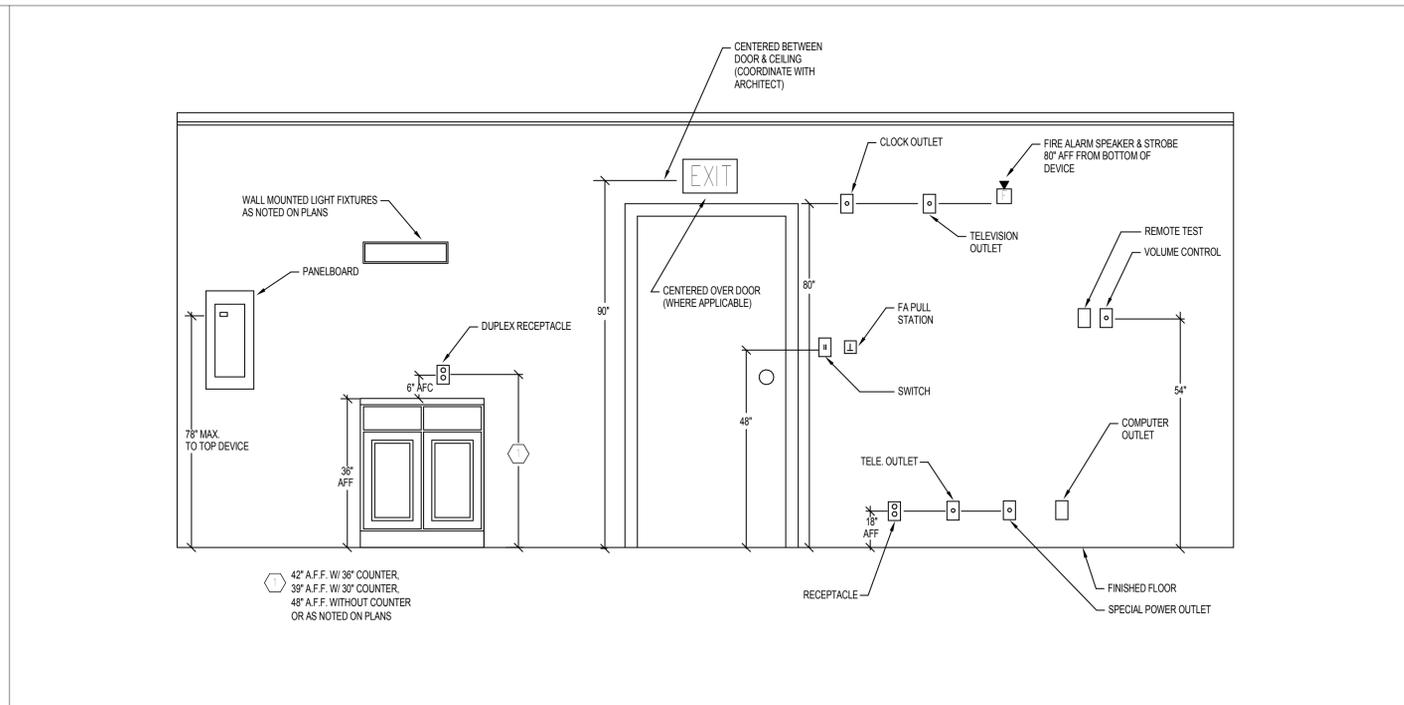


**MOUNTING HEIGHTS**  
No Scale

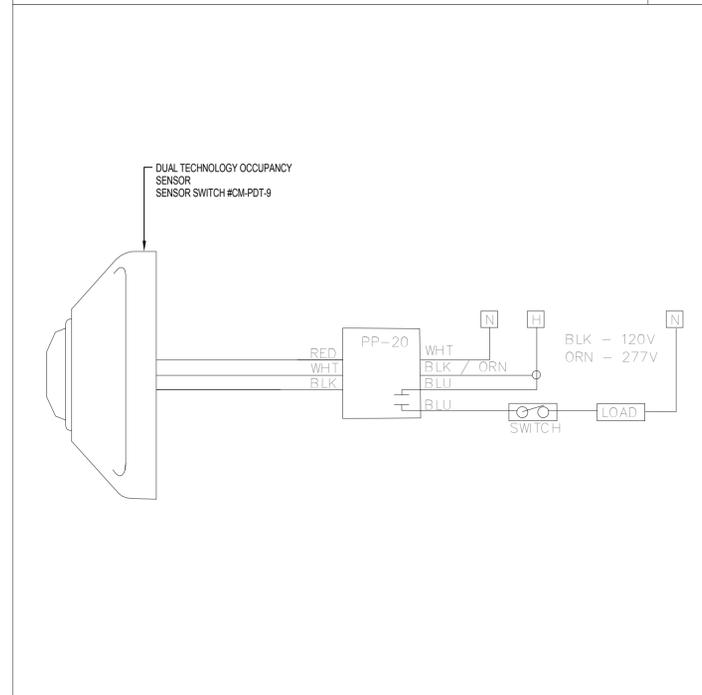

**TYPICAL OCCUPANCY SENSOR WIRING**  
No Scale

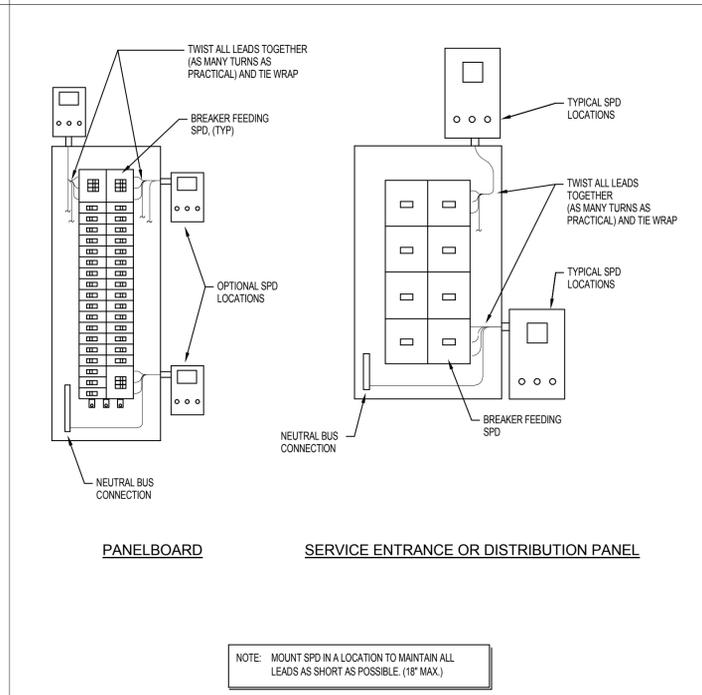

**SURGE PROTECTION DEVICE EXTERIOR MOUNT INSTALLATION**  
No Scale

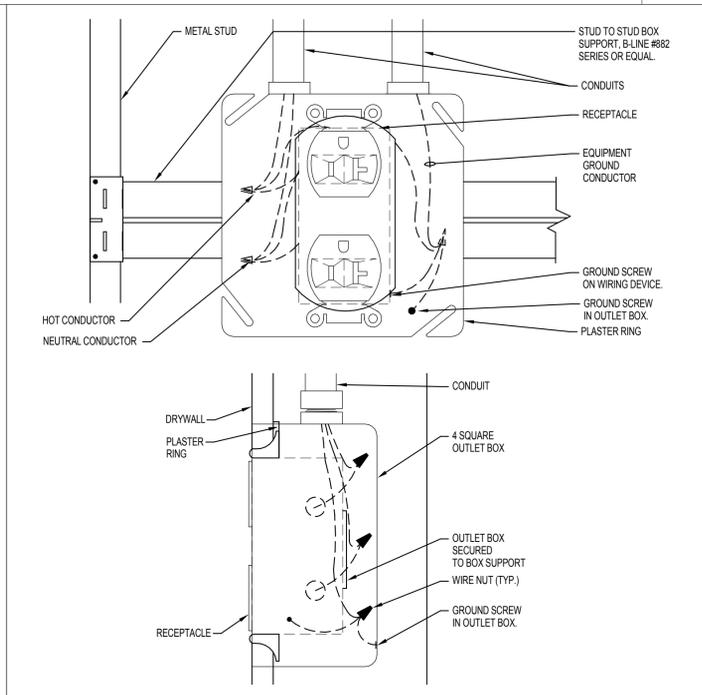

**TYPICAL RECEPTACLE MOUNTING DETAIL**  
No Scale

C:\Users\ojan.saujo\Desktop\REVIT SHIT\Revit 2016\15185\_Dr Vakani Rouse\_MEF\_Central\_R16.rvt  
 4/25/2016 2:02:32 PM

REVISIONS	
REVISION 1	2/4/16

JOB NO.	11-523
DATE	01.28.16
DRAWN BY	BWM
CHECKED BY	SBC