



REVISIONS	
REVISION 1	2/4/16

JOB NO.	11-523
DATE	01.28.16
DRAWN BY	LTB
CHECKED BY	JTW

KEYNOTES:

- 1 18" X 18" OA LOUVER, PROVIDE BIRD SCREEN, BASIS OF DESIGN GREENHECK ESD-635X. TAMPER FROM LOUVER WITH A MAXIMUM OF 45° ANGLE TO 8"X8" DUCT
- 2 ROUTE 6" DIAMETER EXHAUST TO WALL LOUVER (BRICK VENT BROAN OR EQUAL), BASIS OF DESIGN: BROAN - MODEL 612
- 3 FIELD ROUTE REFRIGERANT PIPING TO AHU (TYP OF 2).

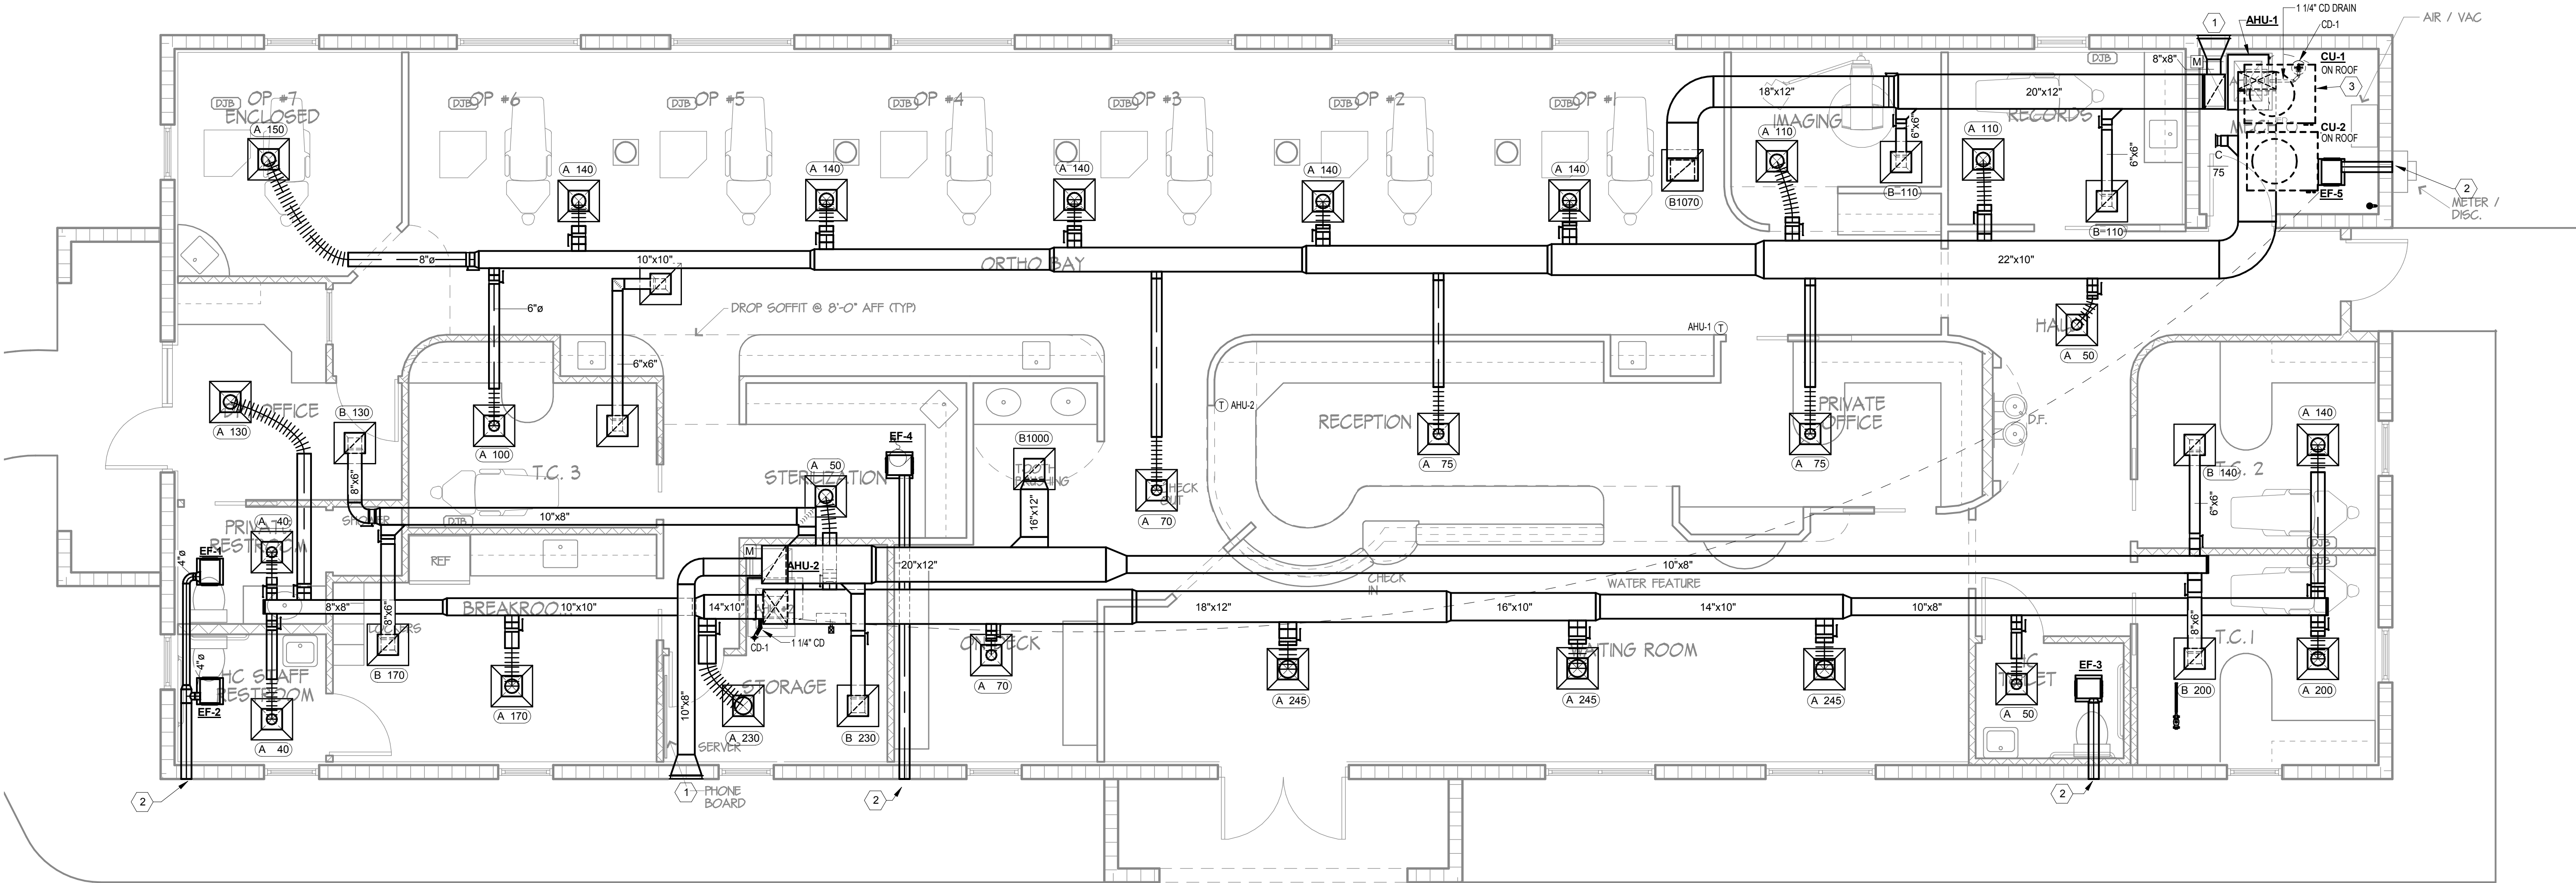


MECHANICAL FLOOR PLAN
 1/4" = 1'-0"