




**CEILING MOUNTED FAN DETAIL**

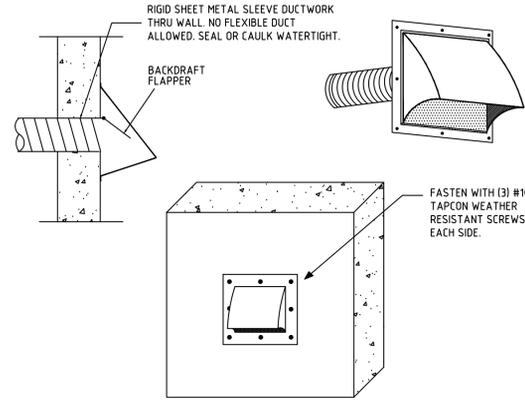

**WALL CAP DETAIL**

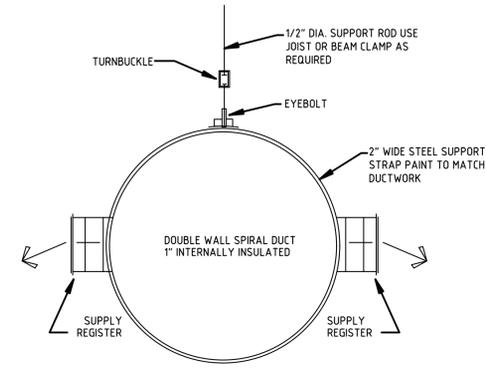


**EXPOSED DUCT SUPPLY REGISTER DETAIL**

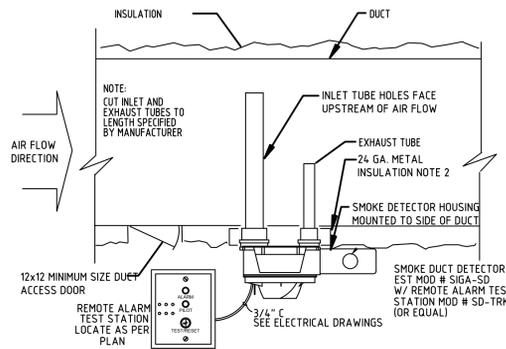


**NOTES:**  
 1. DETAIL SHOWS GENERAL INSTALLATION METHODS. REFER TO INDIVIDUAL MANUFACTURER FOR THEIR SPECIFIC INSTALLATION AND LOCATION INSTRUCTIONS.  
 2. STANDOFF BRACKET NOT REQUIRED ON NON-INSULATED DUCT.  
 3. CONNECT DUCT DETECTOR TO BUILDINGS FIRE ALARM SYSTEM IN ACCORDANCE WITH FBC-M 606.4.1

**DUCT MOUNTED SMOKE DETECTOR DETAIL**

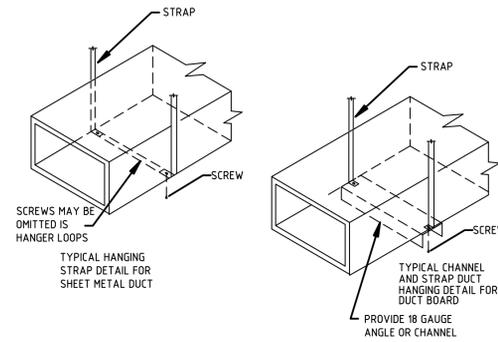

**NOTE: ALL STRAP SHALL BE A MINIMUM OF 1-1/2, 26 GA GALVANIZED STEEL WITH A 6 FT MAXIMUM SPACING.**

**METHODS OF HANGING RIGID DUCT DETAIL**

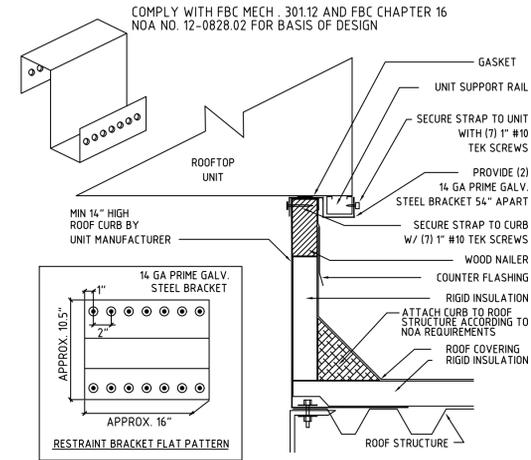

**RTU MOUNTING DETAIL**



TO THE BEST OF MY KNOWLEDGE THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH THE 2014 FLORIDA BUILDING CODE, ALL AMENDMENTS AND SECTION 633 OF THE FLORIDA STATUTES.

**MECHANICAL DETAILS**

AS NOTED

PROGRESS SET/NFC 03/04/2016

M  
2.1