


KEYNOTES:

- 1 ROUTE 1/2" FILTERED WATER BELOW SLAB TO FLOOR MOUNT UTILITY BOX. PLUMBING CONTRACTOR TO MAKE FINAL CONNECTIONS.
- 2 PROVIDE MANUAL SHUTOFF VALVE AT ENTRANCE. PROVIDE SOLENOID SHUTOFF BALL VALVE (NORMALLY CLOSED), 14V, WIRED TO SWITCH AT RECEPTION. PROVIDE TRANSFORMER AND LOW VOLTAGE WIRING.
- 1 WATER SHUTOFF SWITCH. PERMANENTLY LABEL 'EMERGENCY WATER SHUTOFF'.

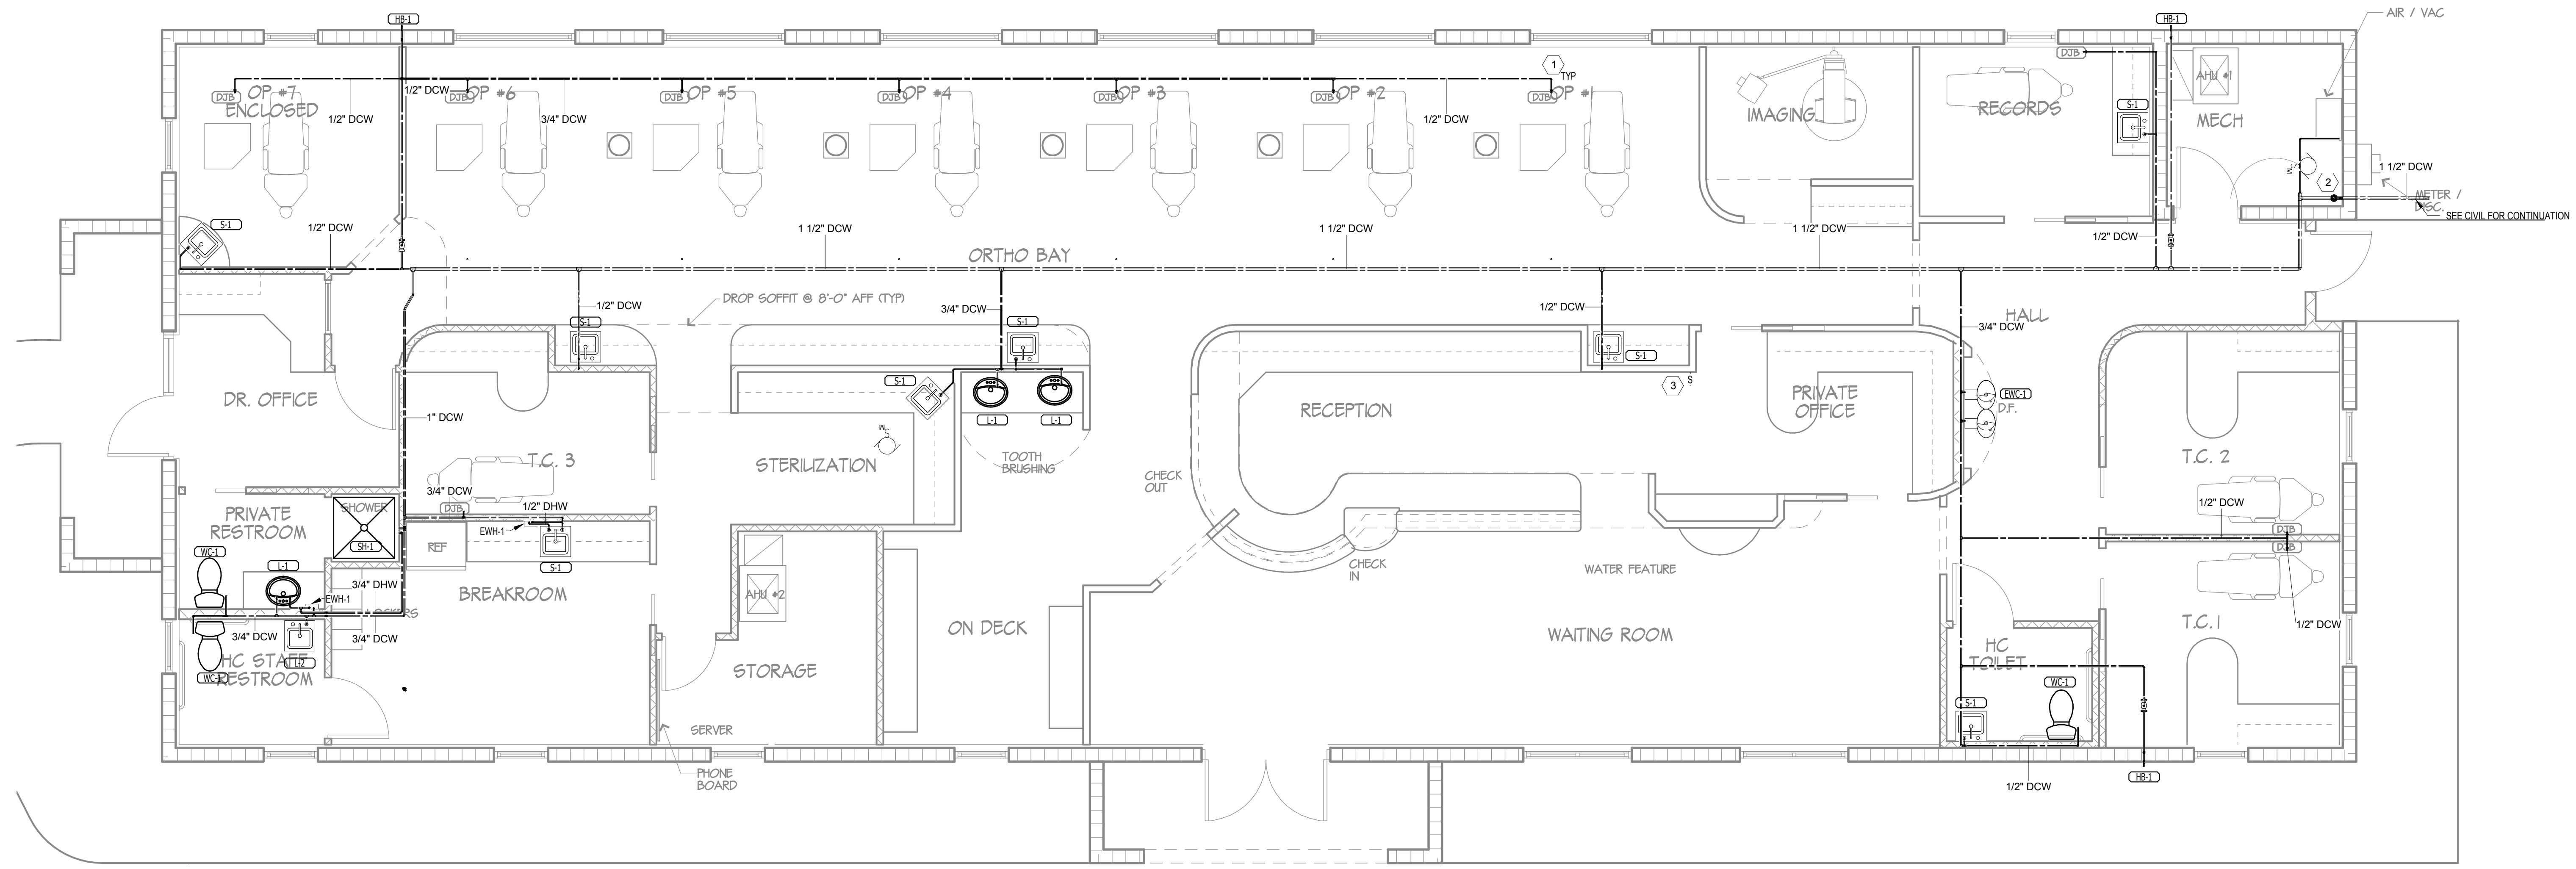

First Floor Plumbing Pressure
 1/4" = 1'-0"

PROPOSED ORTHODONTISTS OFFICE FOR:
DR. VAKANI
 EDGARCE ST., PORT ST. LUCIE,
 FLORIDA

JAMES T. WANSLEY,
 P.E.
 Florida License #60343

REVISIONS	
REVISION 1	2/4/16

JOB NO.	11-523
DATE	01.28.16
DRAWN BY	LTB
CHECKED BY	JTW

SHEET
P-2
 OF