


|  | CAL EQUIPMENT | T AND FEEDER SCHEDULE |
|--|---------------|-----------------------|
|--|---------------|-----------------------|

| ENT<br>PTION | FEEDER<br>DESIGNATION | DISCONNECT |      |       | MOTOR   | KEY   |
|--------------|-----------------------|------------|------|-------|---------|-------|
|              |                       | FRAME      | FUSE | POLES | STARTER | NOTES |
| J—1          | 3197–26,28,30         | 200A       | 2    | 3     | -       | 1     |
| -2           | 3199–24,26,28         | 200A       | 2    | 3     | -       | 1     |
| 1            | 3199–25,27            | 20         | -    | 2     | -       | 3     |
| 2            | 3193–20,22            | 20         | _    | 2     | _       | 3     |
|              |                       |            |      |       |         |       |

2 PROVIDE FUSES AS RECOMMENDED BY EQUIPMENT MANUFACTURER PROVIDE 20A/2P TOGGLE SWITCH IN WEATHER-PROOF ENCLOSURE FOR DISCONNECT.

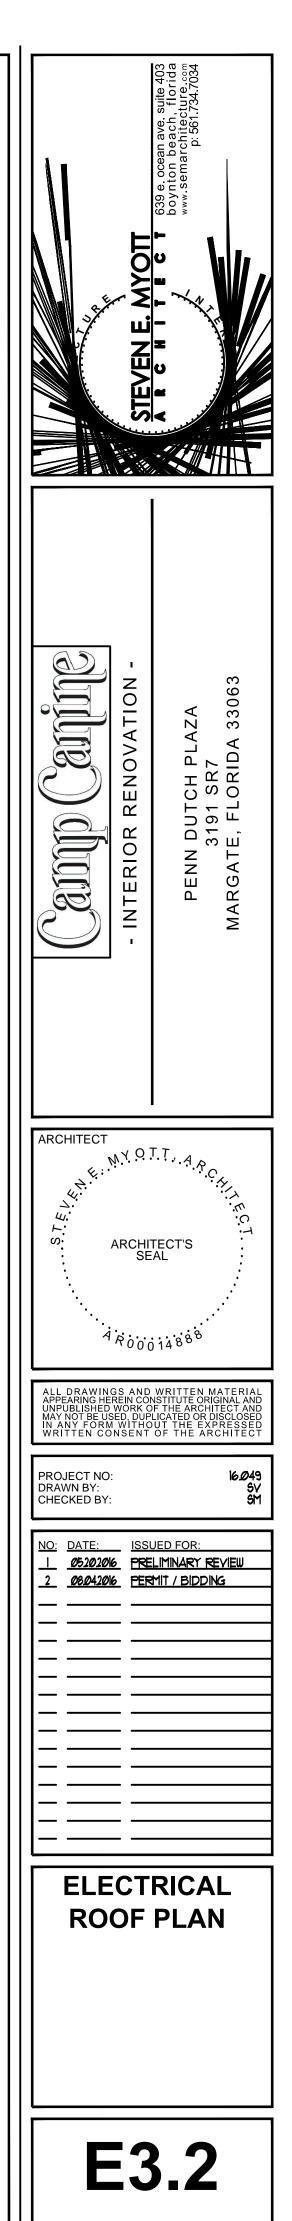

PRINTED ON: 8-4-2016

ISSUED FOR PERMIT 08-04-2016 ISSUED FOR CONSTRUCTION KAMM CONSULTING PROJECT #: 2016-0501 PROJECT MANAGER: NICK RODRIGUEZ

GENERAL NOTES:

(A) WIRE FEEDER THRU DISCONNECT/STARTER AND OUTLET EQUIPMENT FOR OPERATION.

**Consulting** 1407 West Newport Center Drive Deerfield Beach, Florida 33442 Phone 954.949.2200 Fax 954.949.2201 engineering@kammconsulting.com Certification of Authorization #8189 **08-04-2016** date

signed