New Building For:
OPPORTUNITY IN
EARLY LEARNING CENTER

THESE DRAWINGS ARE FOR THE EXCLUSIVE USE OF GLIDDEN SPINA + PARTNERS, INC. AND MAY NOT BE DUPLICATED, REPRODUCED OR USED IN ANY MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF GLIDDEN SPINA + PARTNERS, INC. ALL RIGHTS RESERVED.

Revisions:


Date: Drawn by: 09.09.16 RB/SK/JS Project Architect:

09.09.16 BID/PERMIT



700 WEST HILLSBORD BLVD. - BLDG. #1, SUITE 204
DEERFIELD BEACH, FLORIDA 33441
TEL: (561) 391-9292 FAX: (561) 391-9898
CERTIFICATE OF AUTHORIZATION NO. 28107 URSULA IAFRATE, P.E. LICENSE #73122 STEPHEN F. ROLLIN, P.E. LICENSE #36428 DONALD H. AUSTIN, JR., PE LICENSE #60651
JASON BARBER, P.E. LICENSE #73050
E-MAIL: INFO@FAECONSULTING.COM
DESIGNED BY: BJ/SK/JS
PM: BJ
P/N 15434

PERMIT / BID SET: 09/07/16

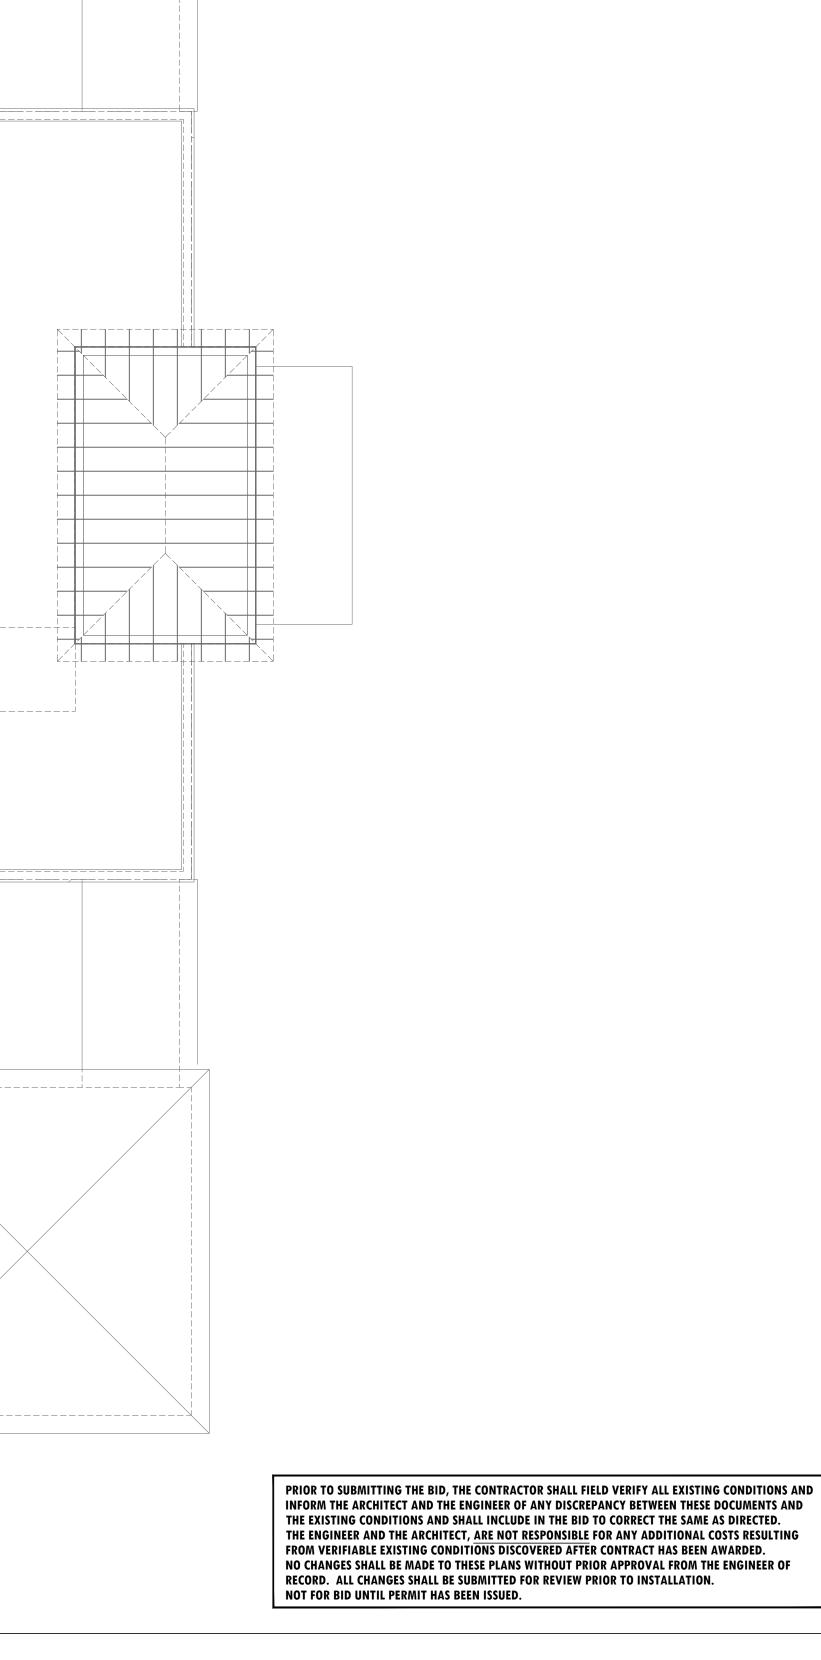

KEY NOTES

ELECTRICAL CONDUIT/FEEDERS FOR THE ROOF MOUNTED UNITS SHALL BE RUN IN SHAFT SPACE AND NOT ON ROOF DECK. OTHERWISE SIZING SHALL BE AS PER NEC 2008 - TABLE 310.15(B)(2)(C)

• CIRCUIT BREAKER/DISCONNECT MUST MAINTAIN 3'-0" CLEARANCE IN FRONT.

CONTRACTOR TO PROVIDE 1/2" EMPTY CONDUIT WITH PULL STRINGS FOR CONTROL WIRING FROM CU TO EQUIPMENT TO THERMOSTAT.

PROVIDE FUSES AS RECOMMENDED BY EQUIPMENT MANUFACTURER.

ROOF TOP EQUIPMENT:

• VERIFY EXACT LOCATION IN FIELD

3P 60A NEMA 3R