




TYPICAL UTILITY INSTALLATION DETAIL IN A 10' UTILITY EASEMENT ADJACENT TO R/W 11W

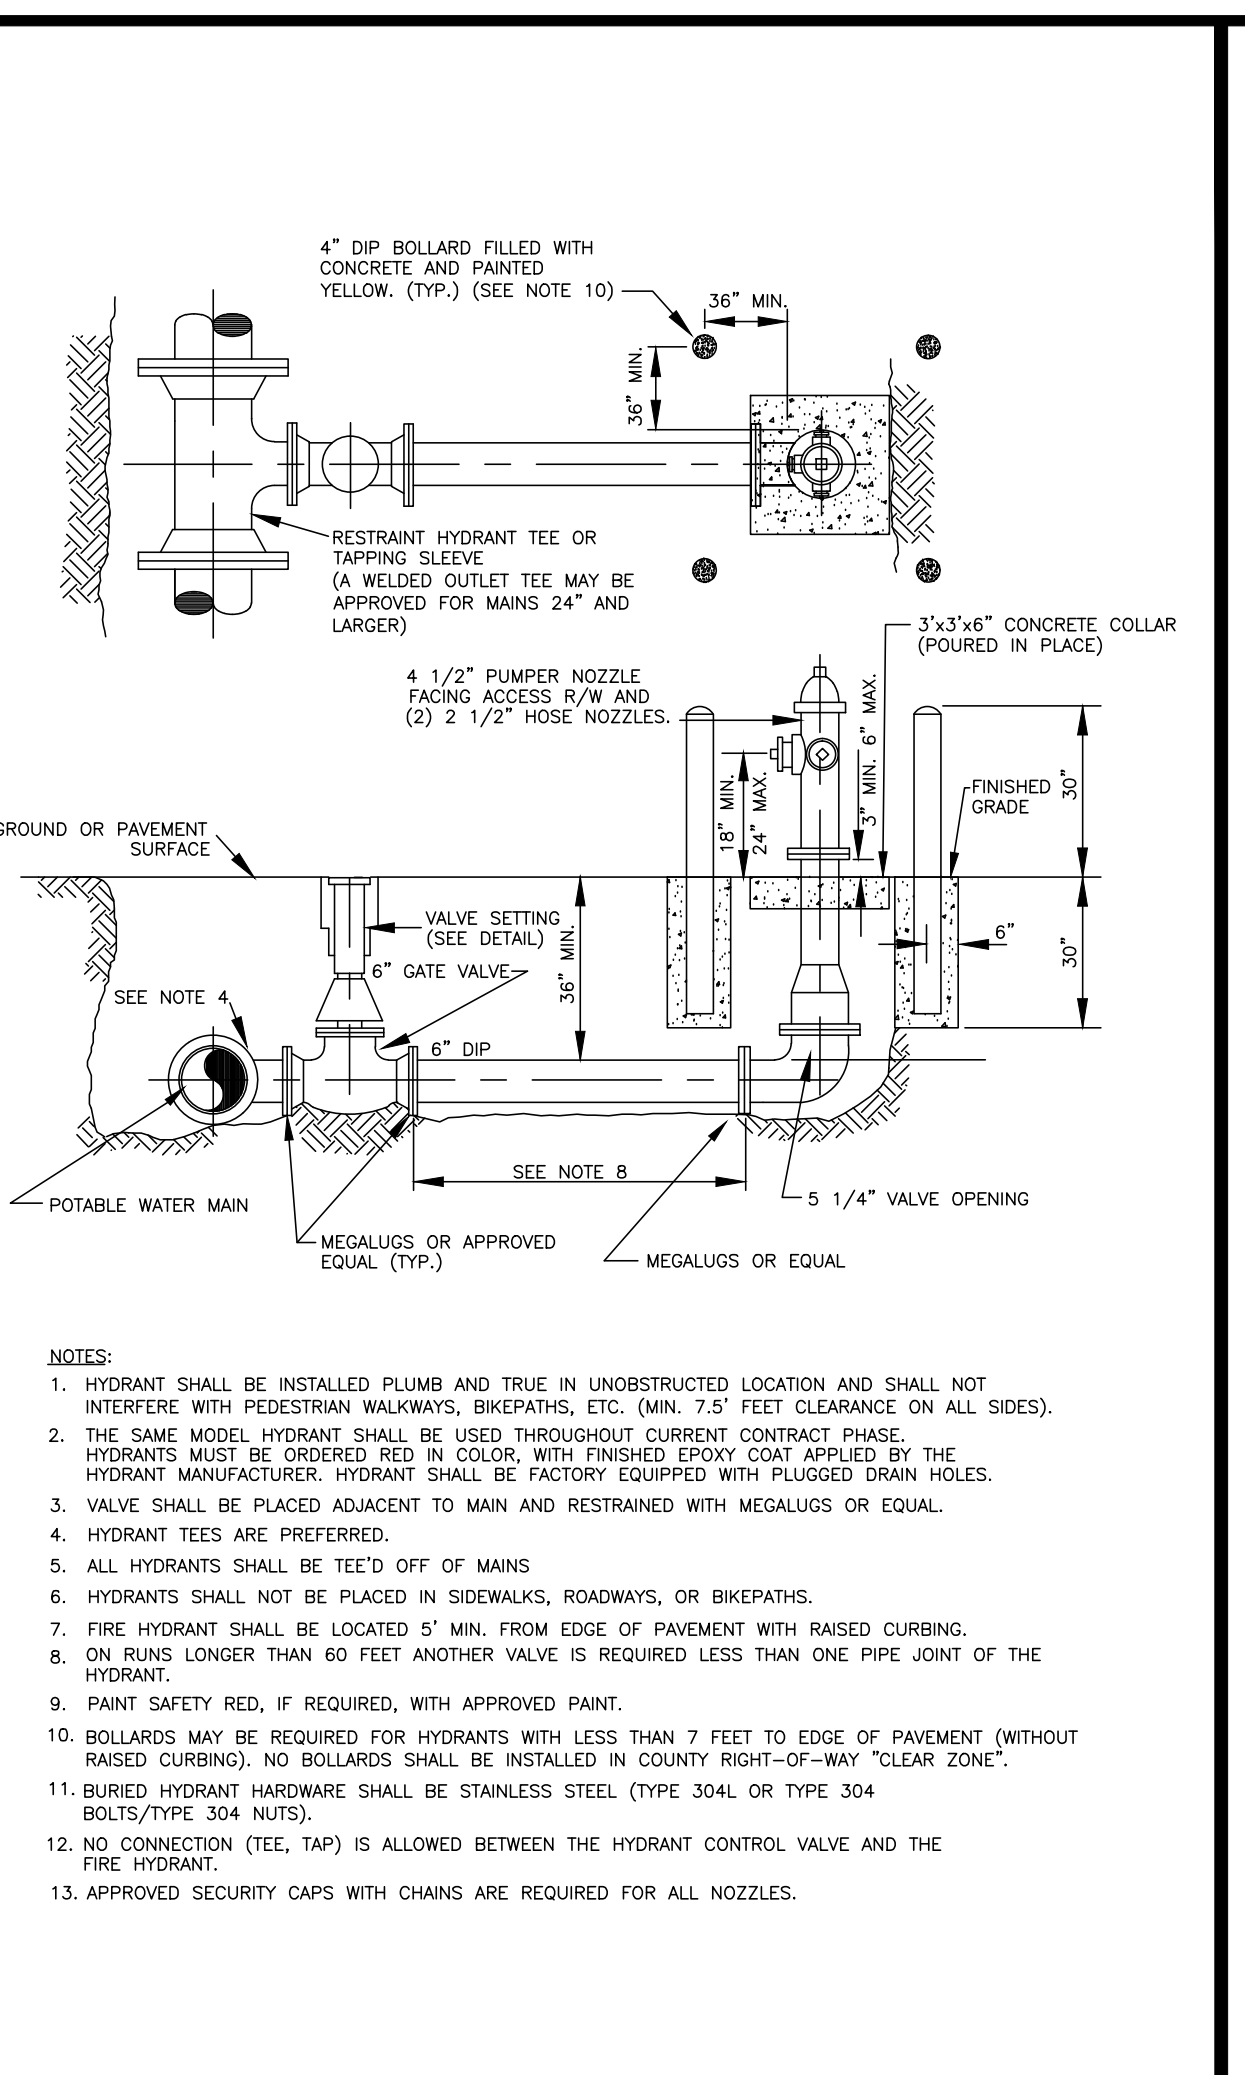


TYPICAL FIRE HYDRANT INSTALLATION WITH BOLLARDS DETAIL 12W

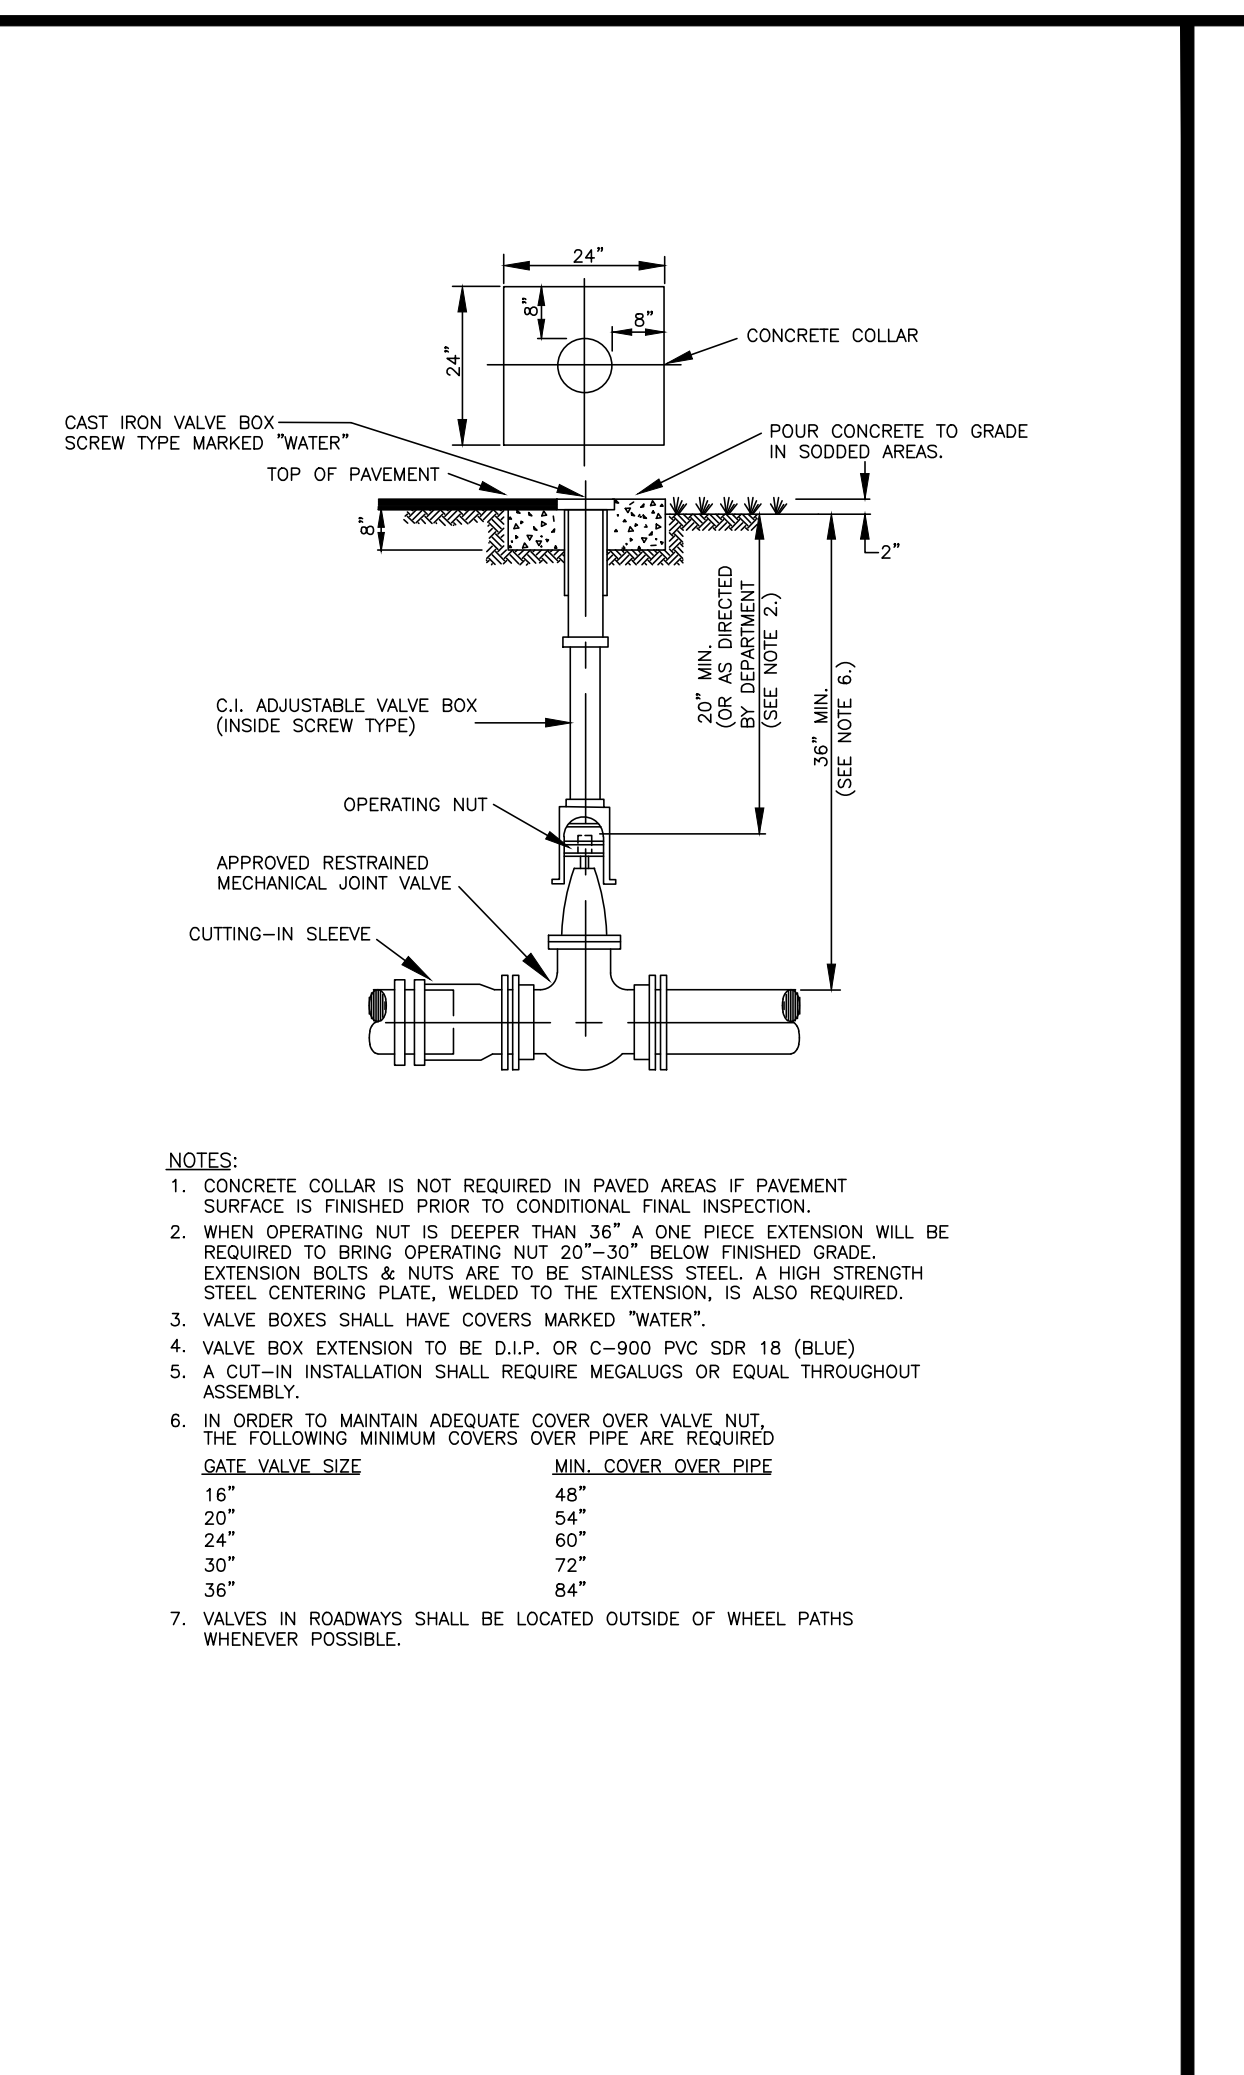


POTABLE WATER MAIN TYPICAL GATE VALVE SETTING AND MAIN CUT-IN DETAIL 13W

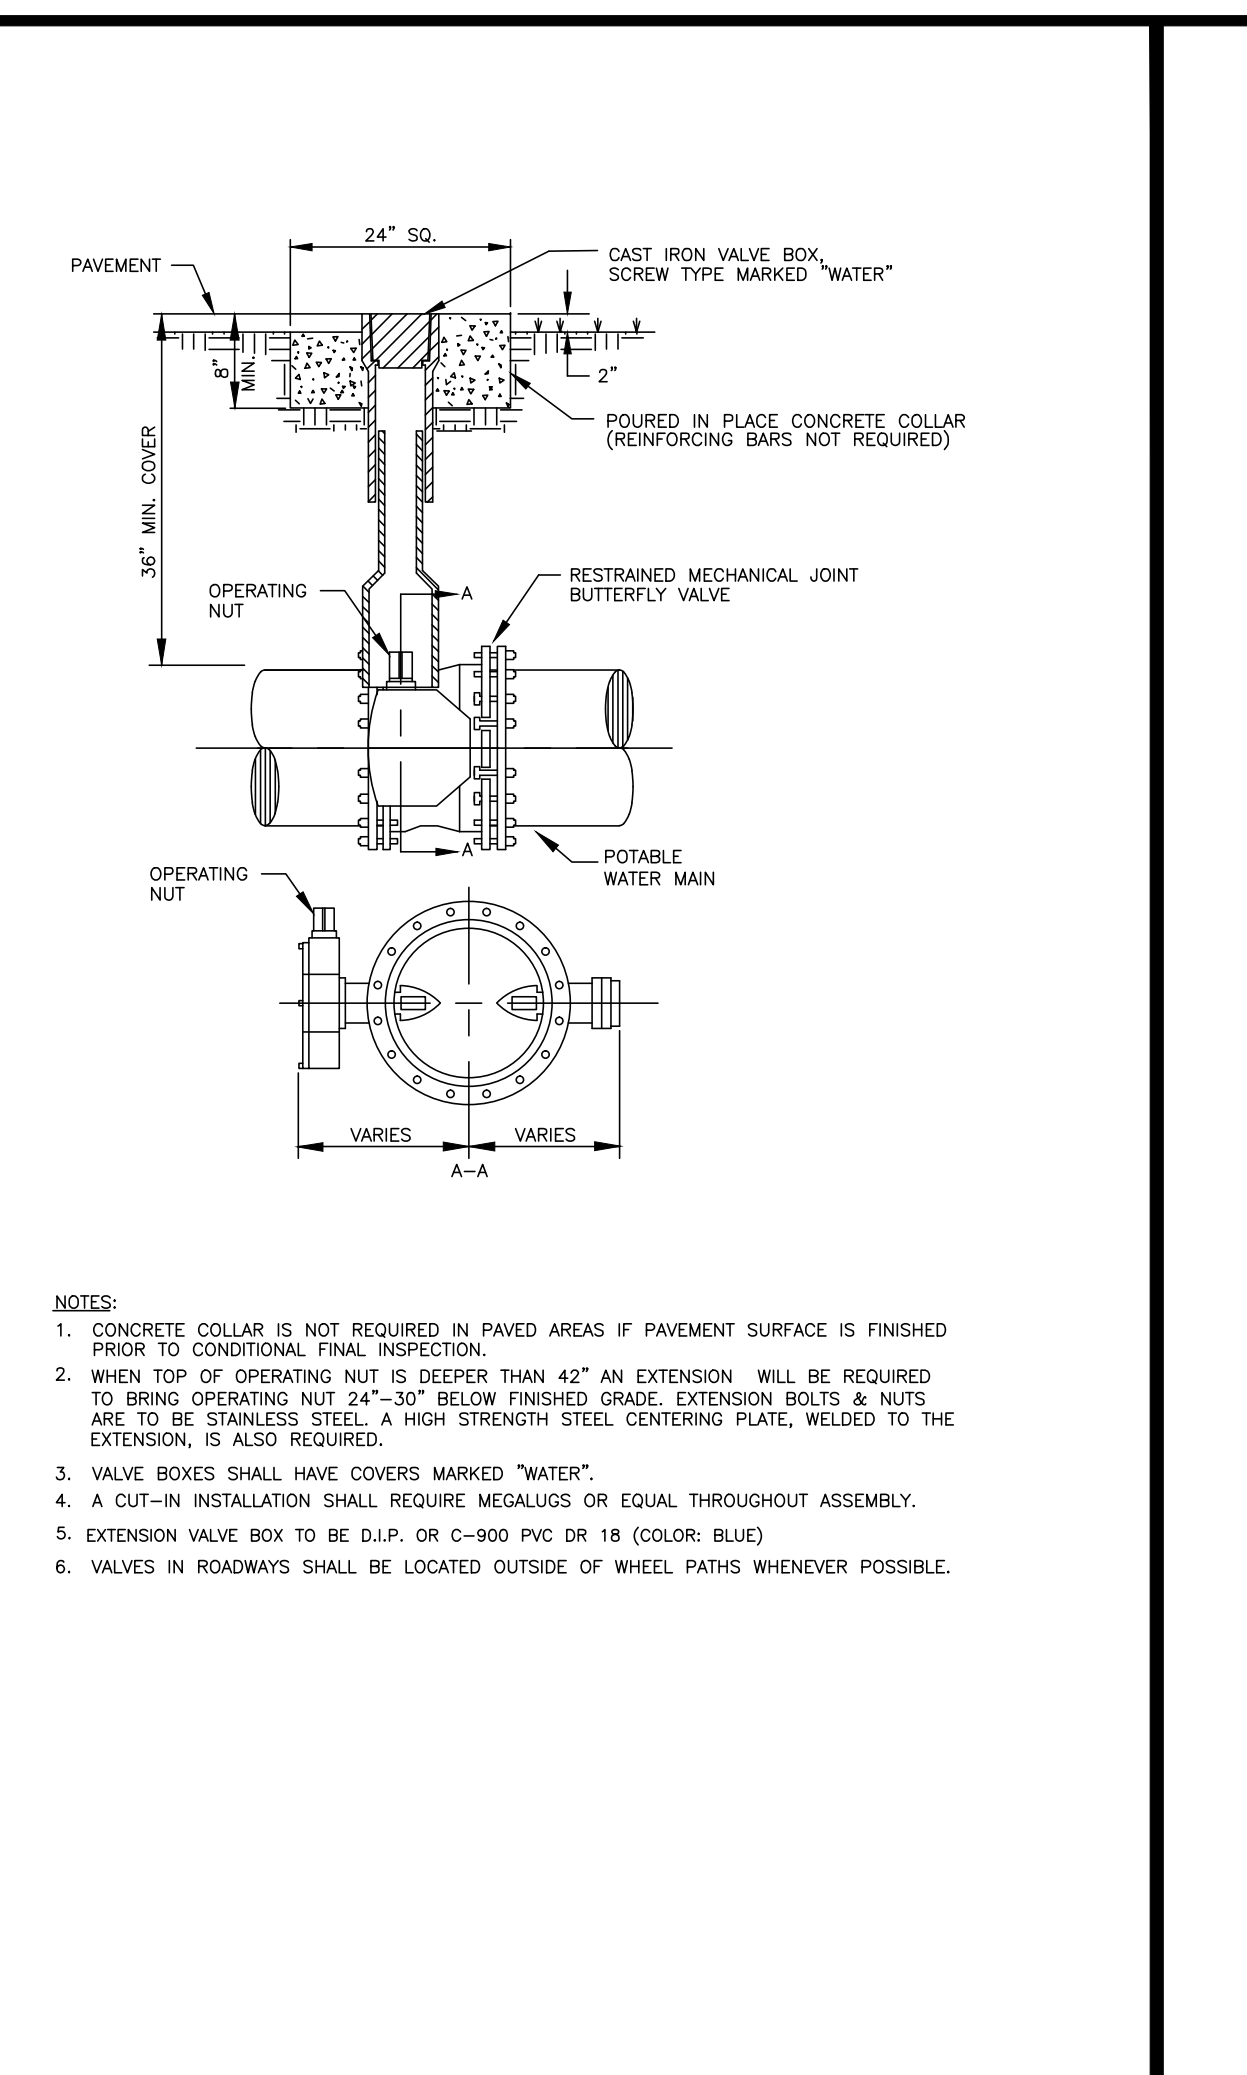


POTABLE WATER MAIN TYPICAL BUTTERFLY VALVE SETTING 14W

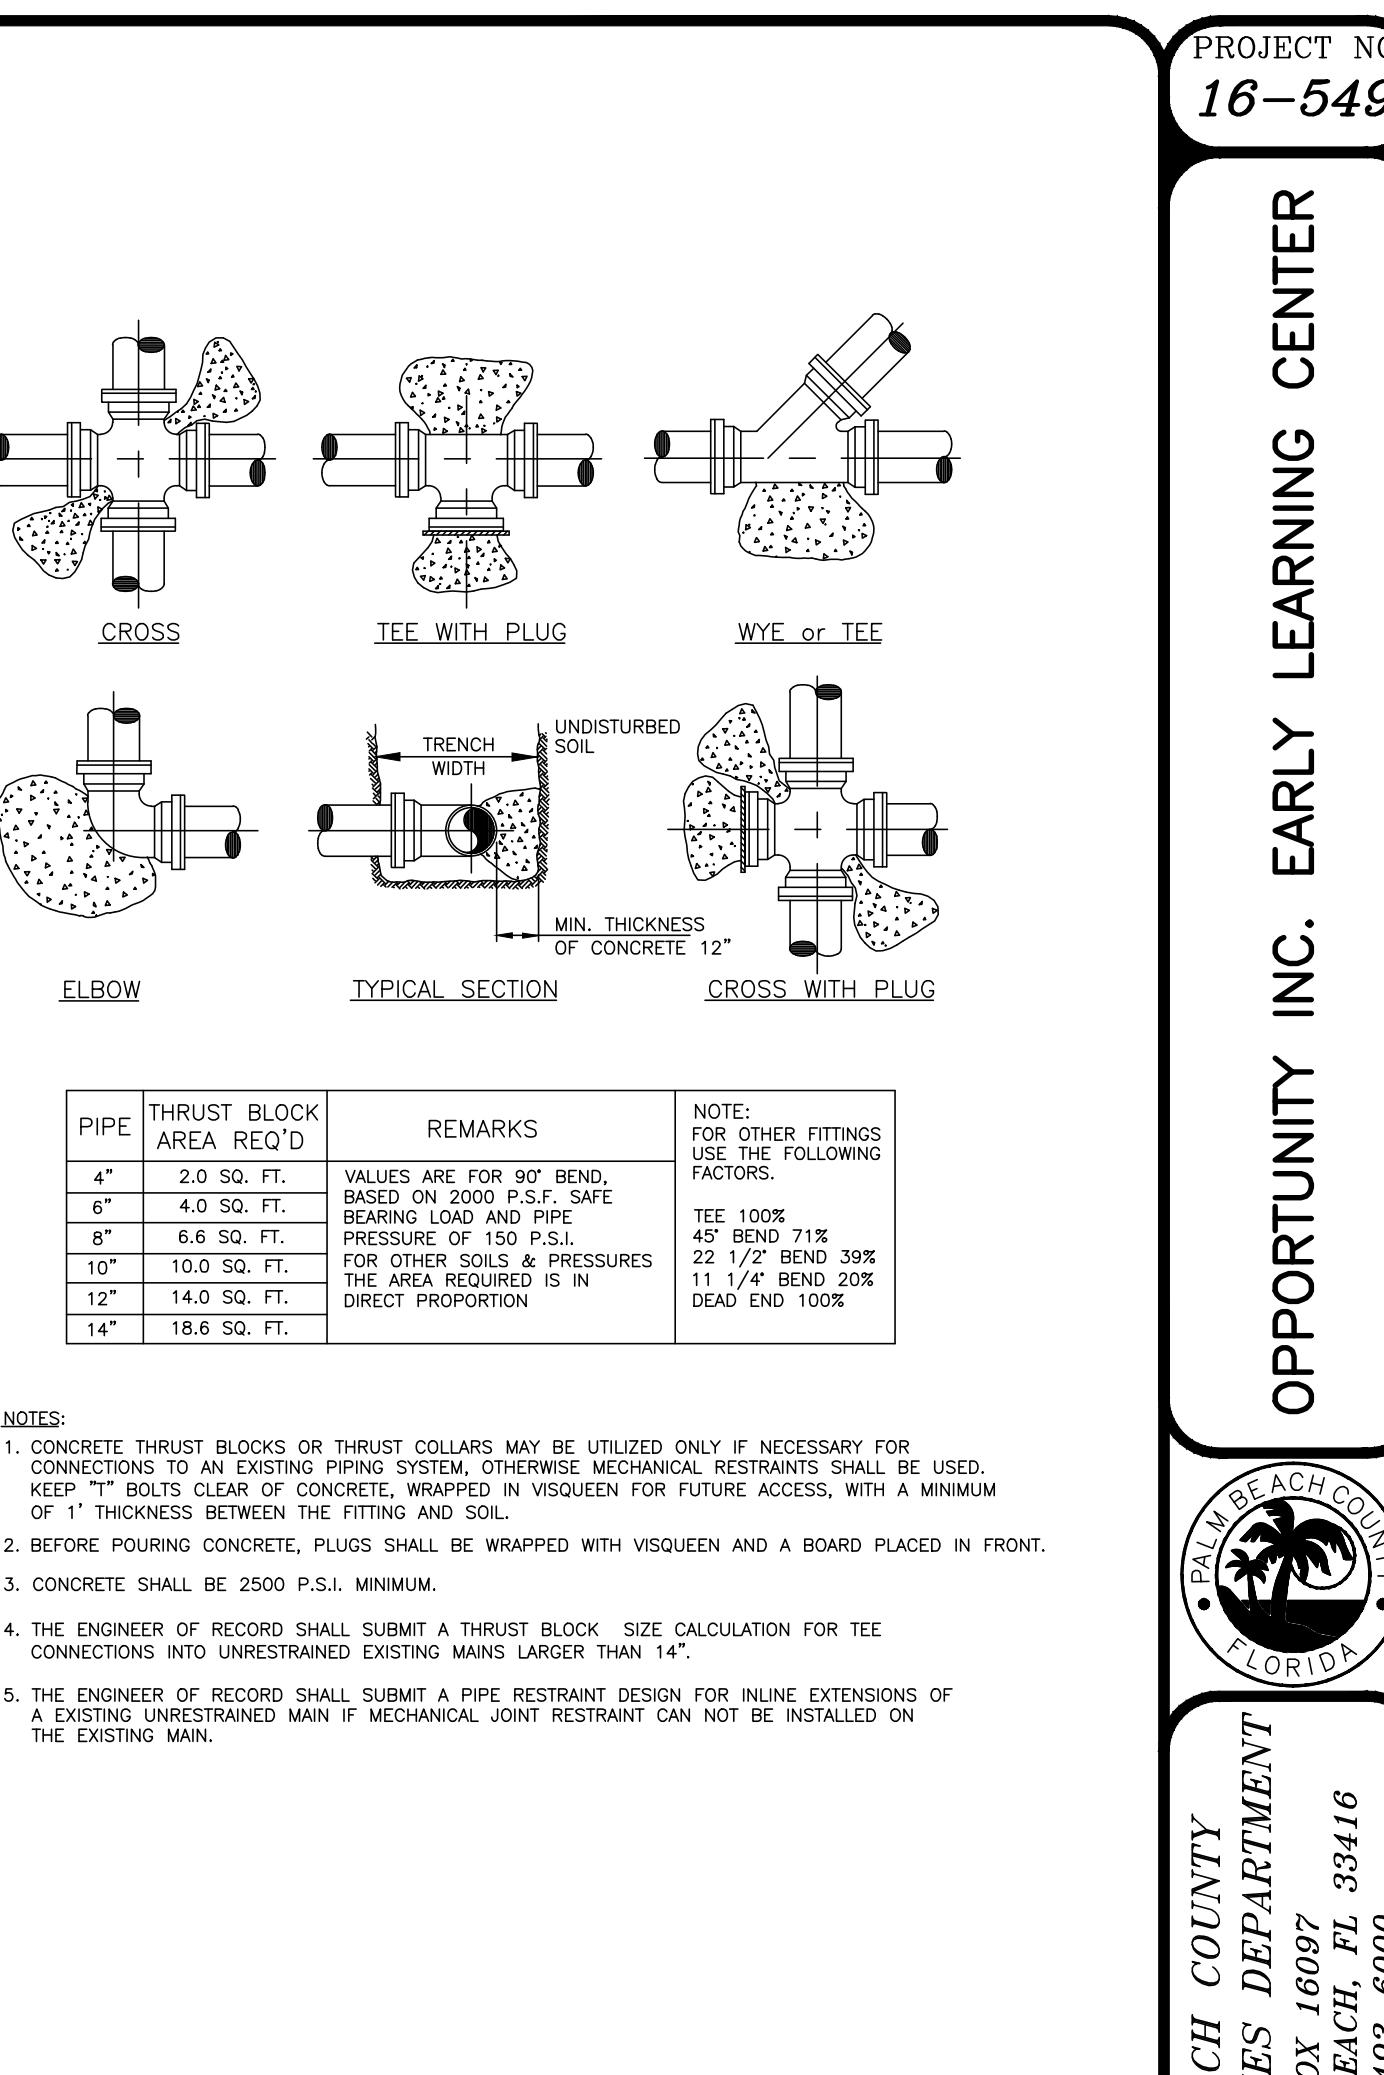


TYPICAL THRUST BLOCKS FOR PRESSURE PIPE 20W

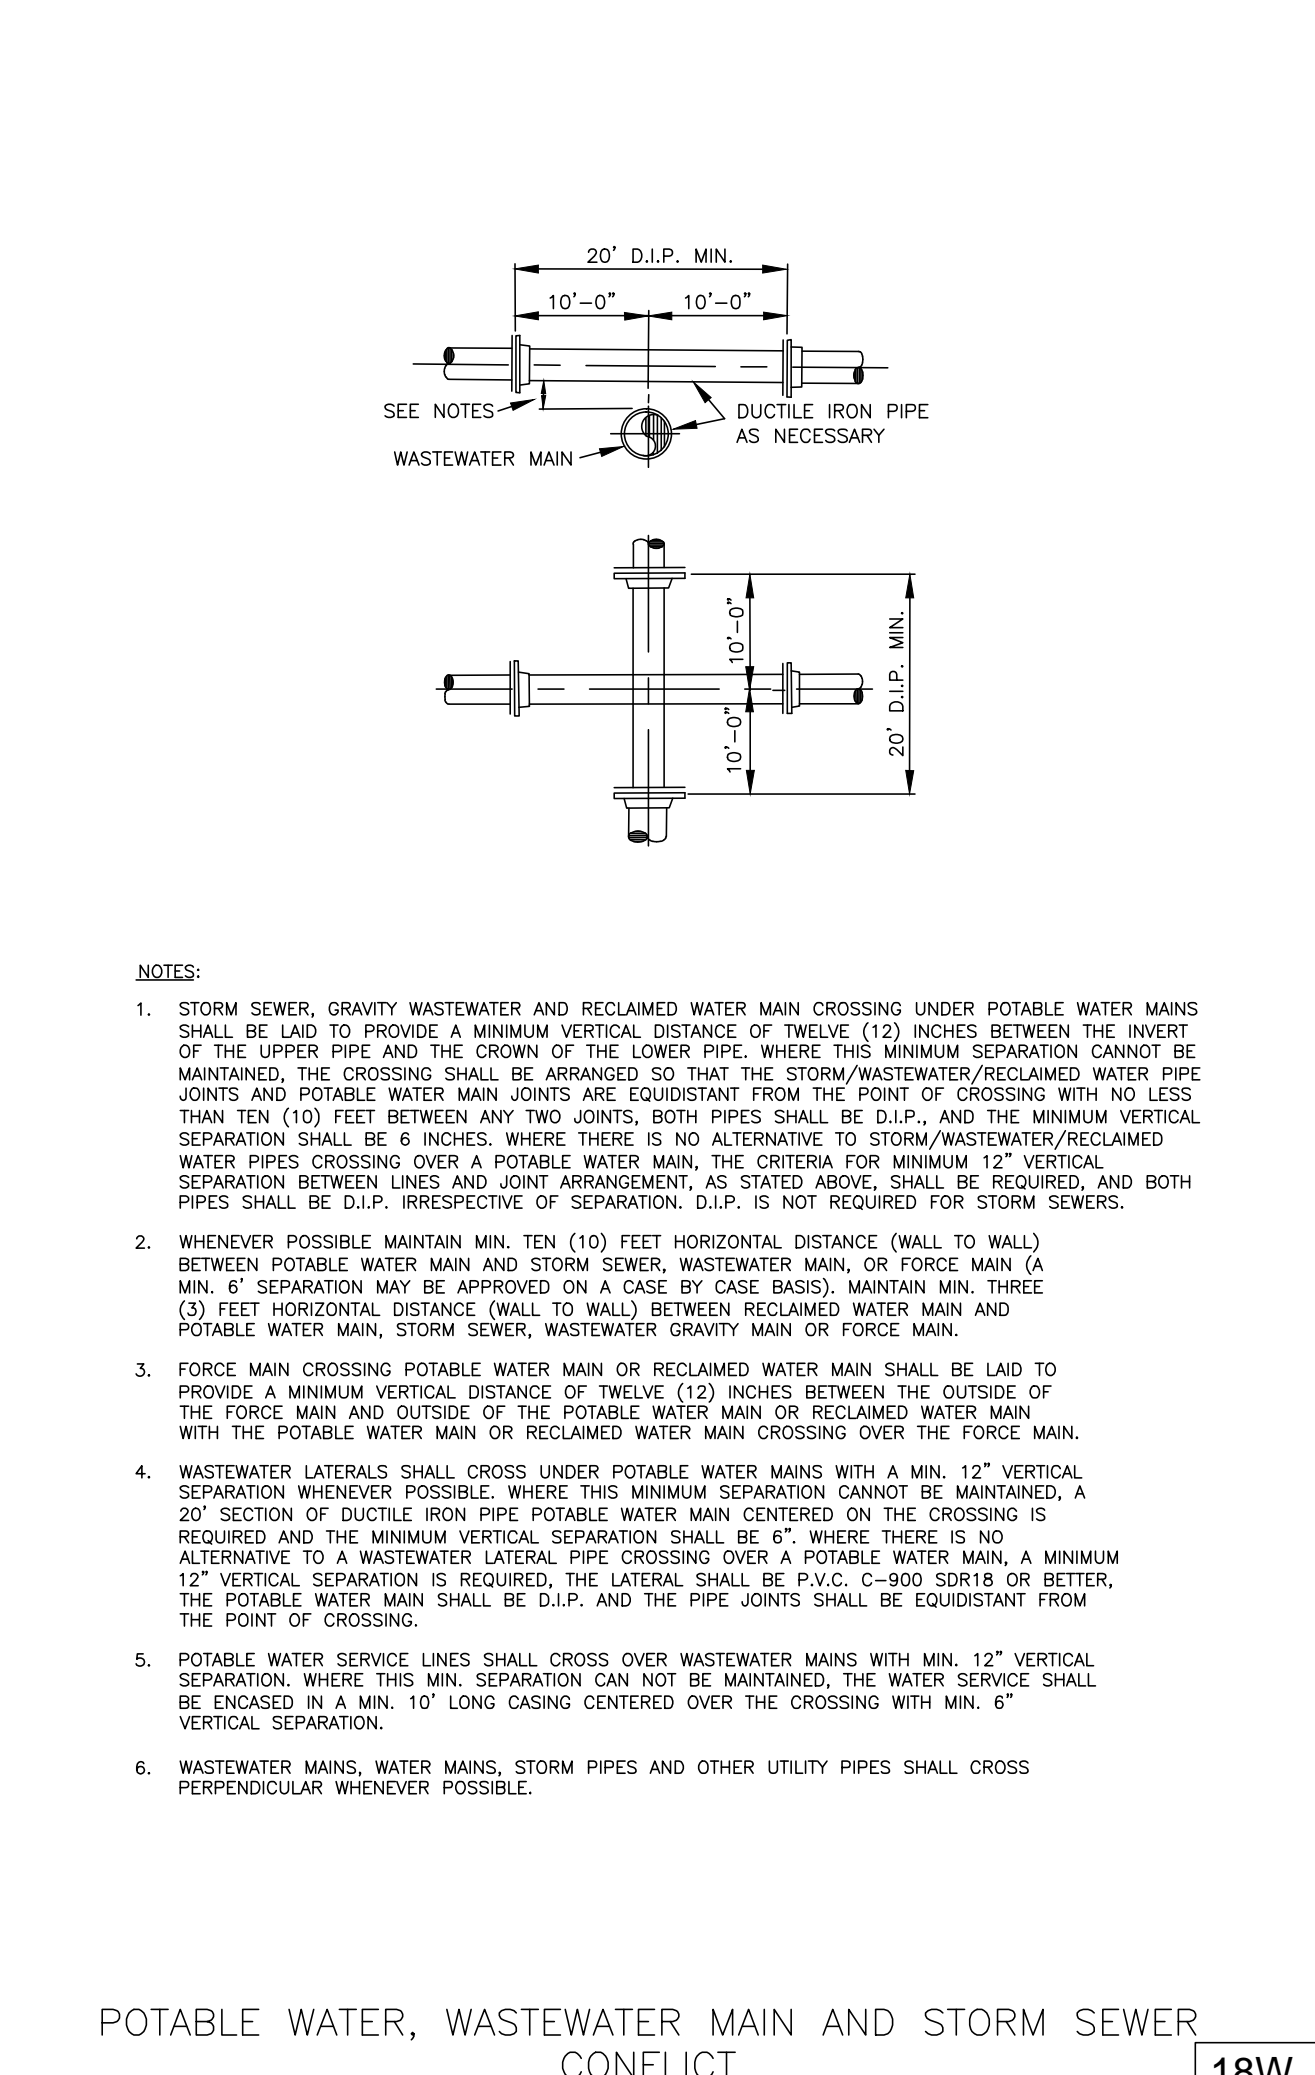


POTABLE WATER, WASTEWATER MAIN AND STORM SEWER CONFLICT 18W

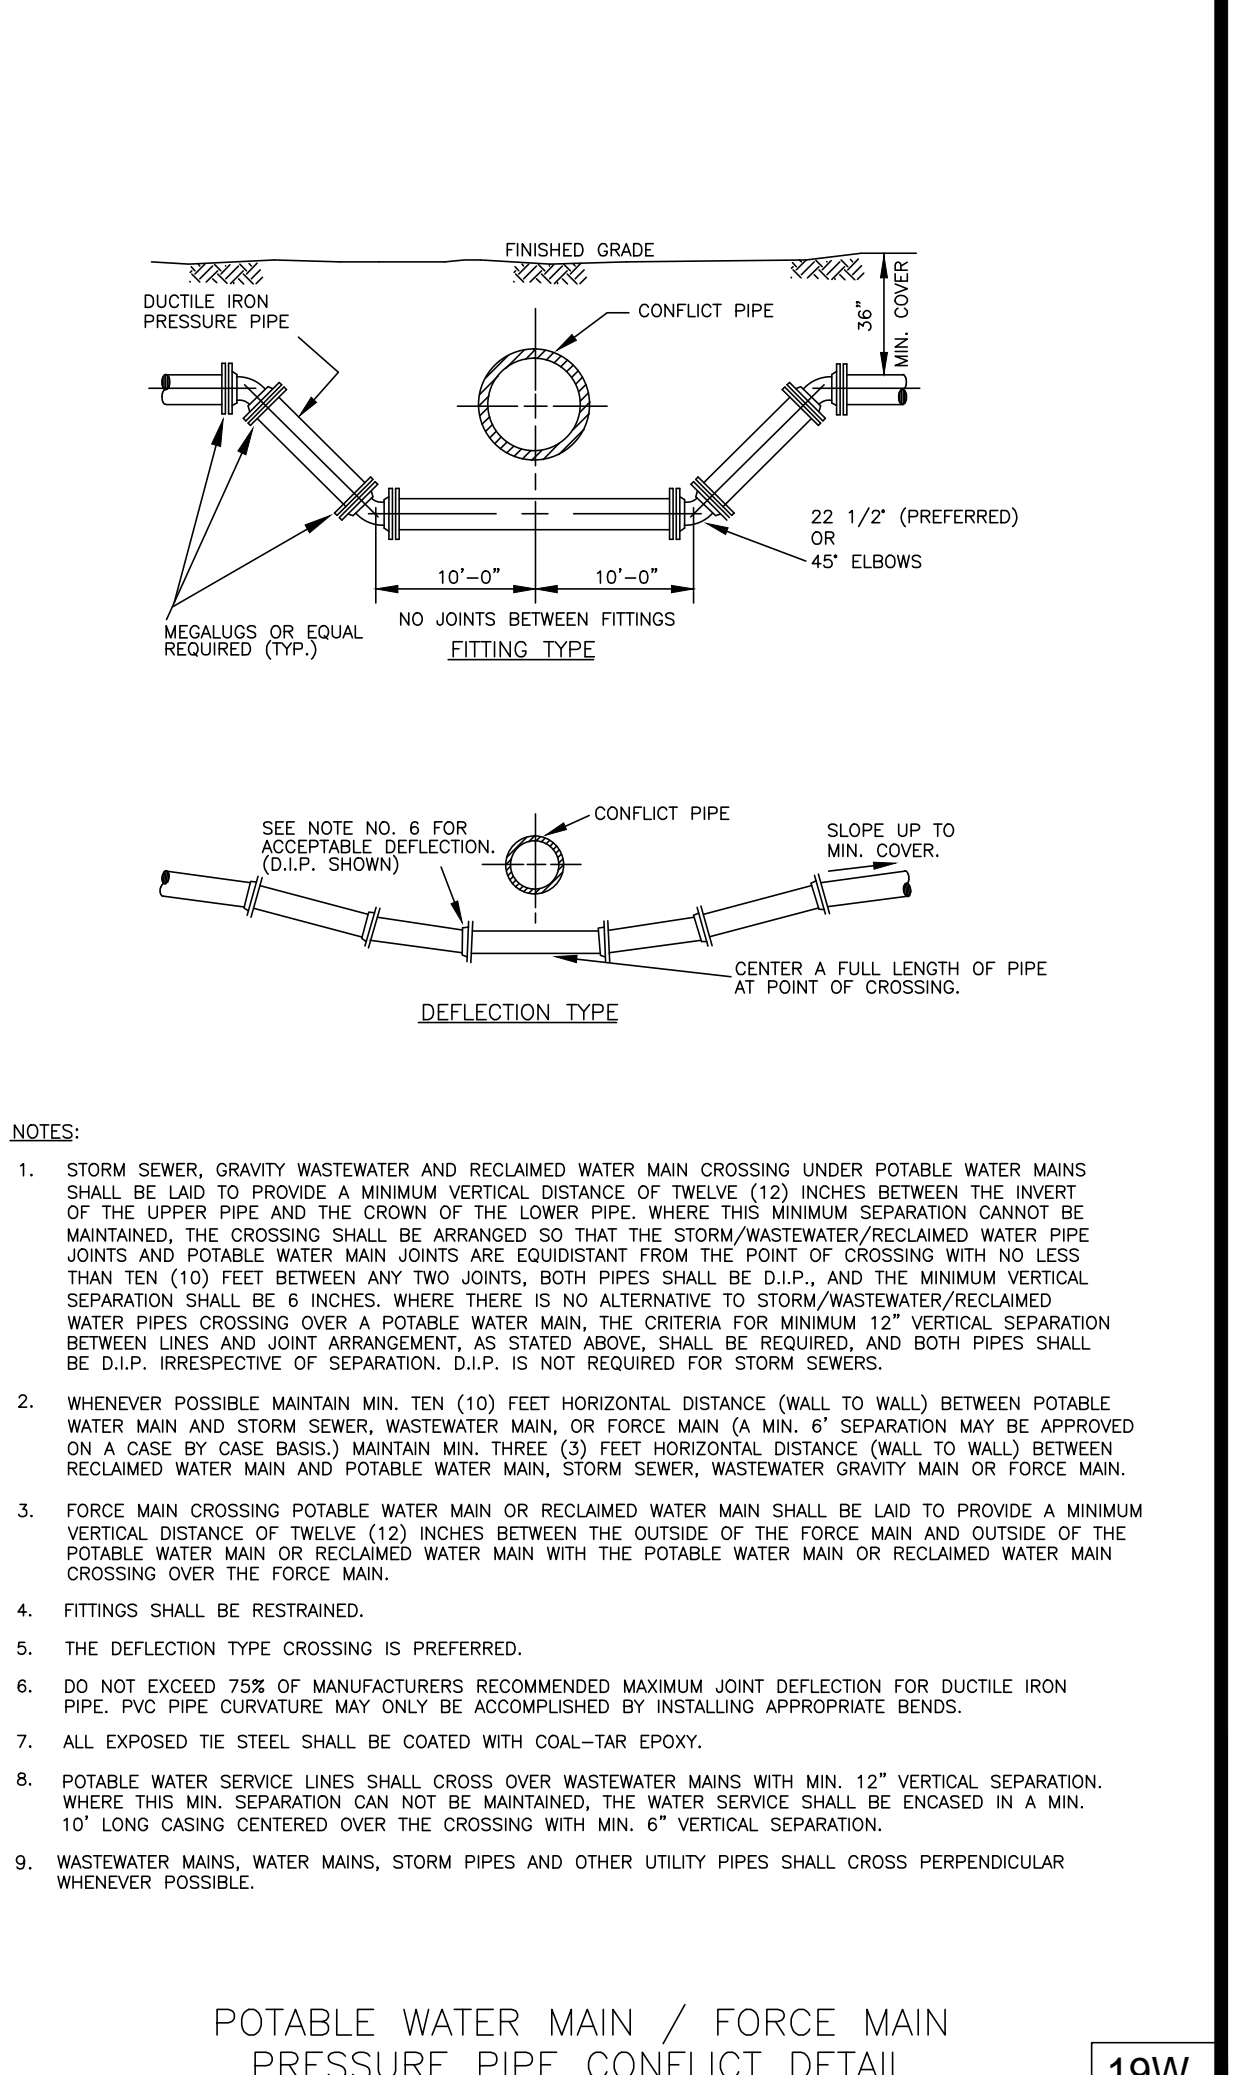


POTABLE WATER MAIN / FORCE MAIN PRESSURE PIPE CONFLICT DETAIL 19W

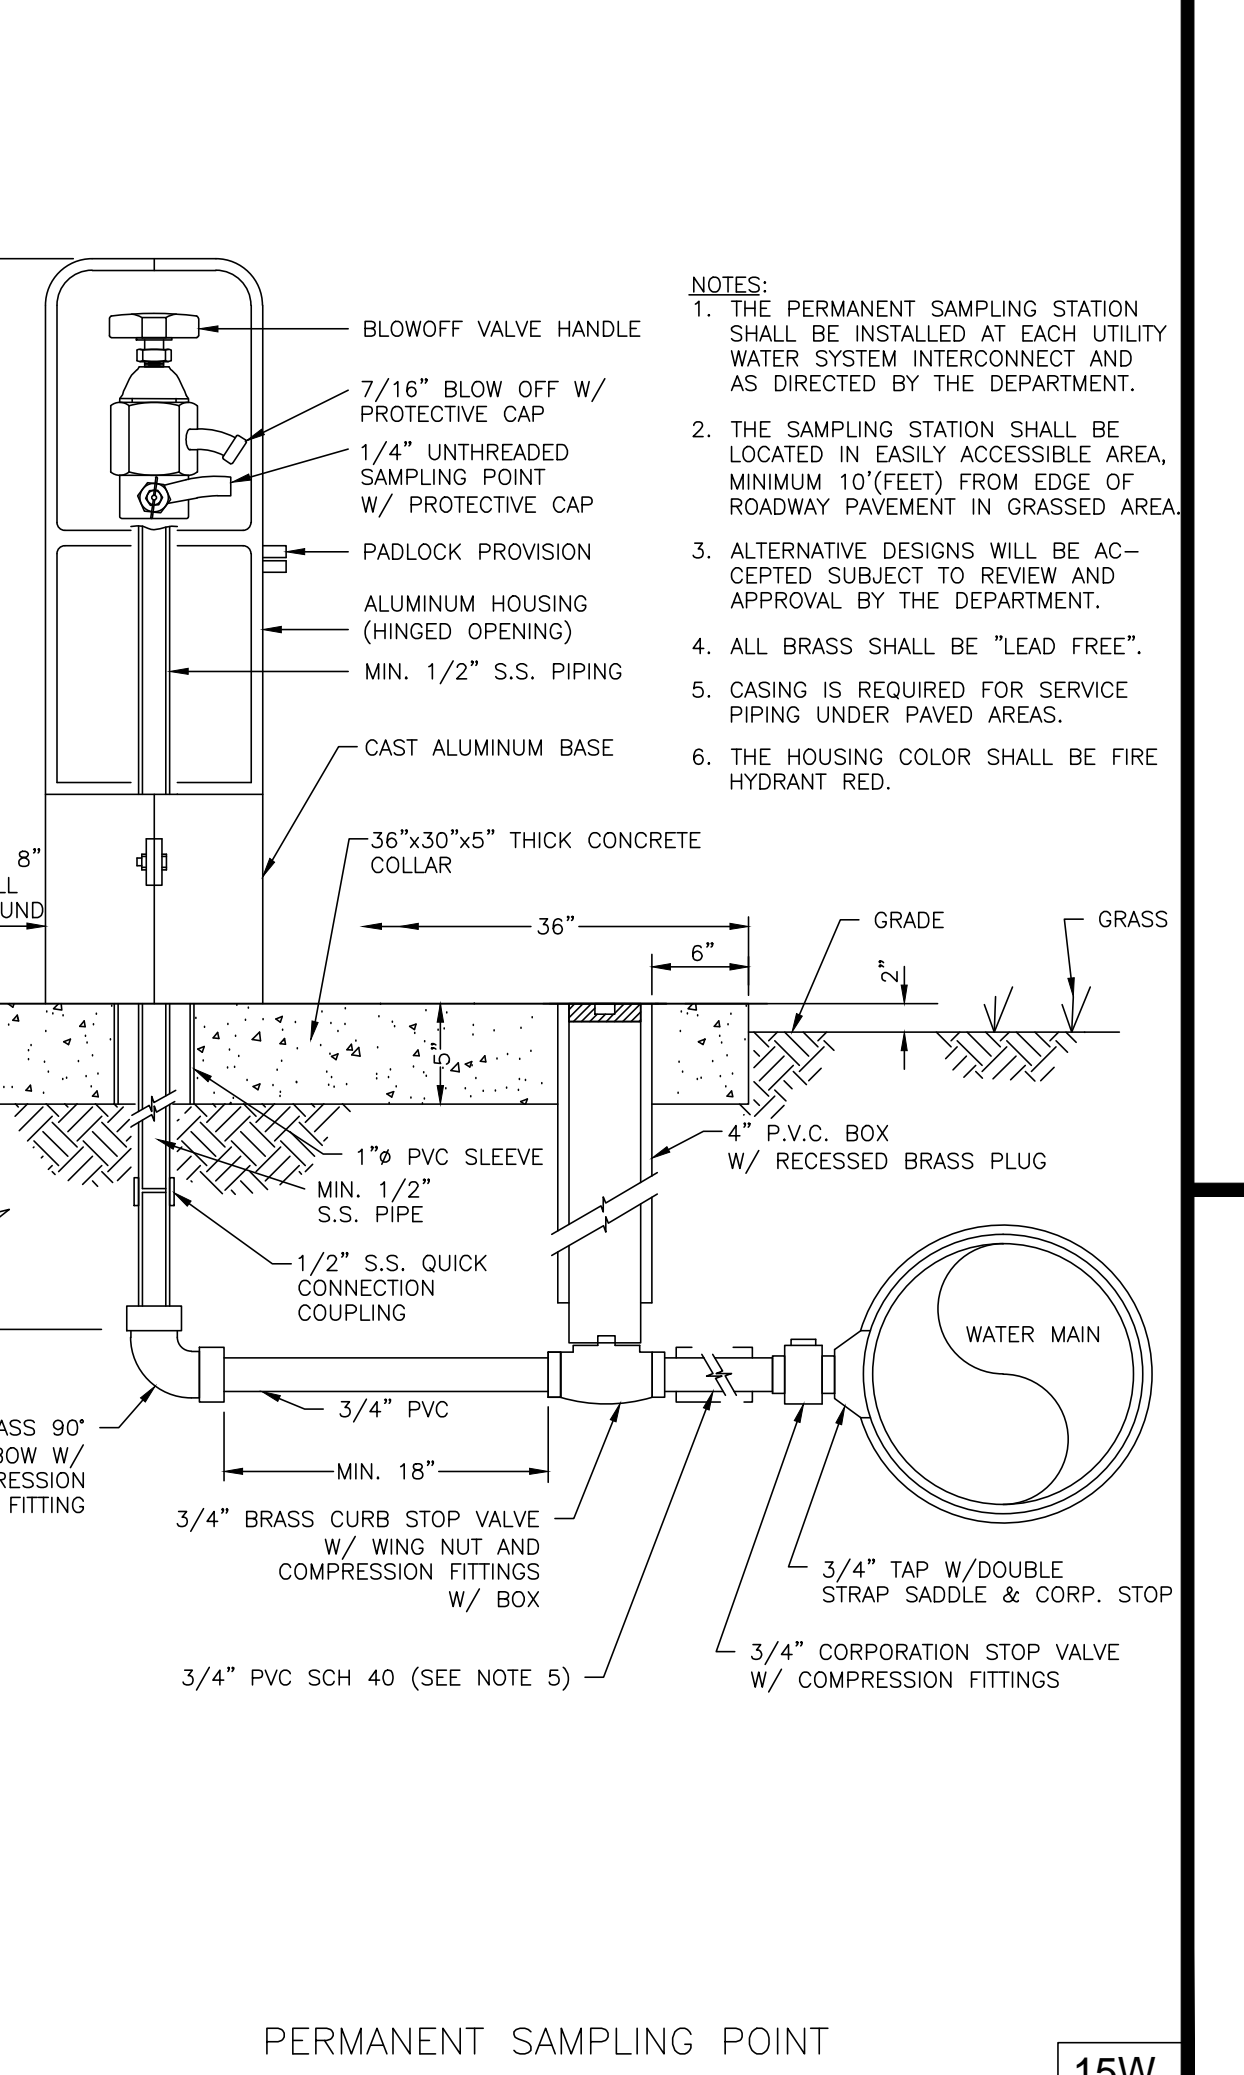

PERMANENT SAMPLING POINT 15W

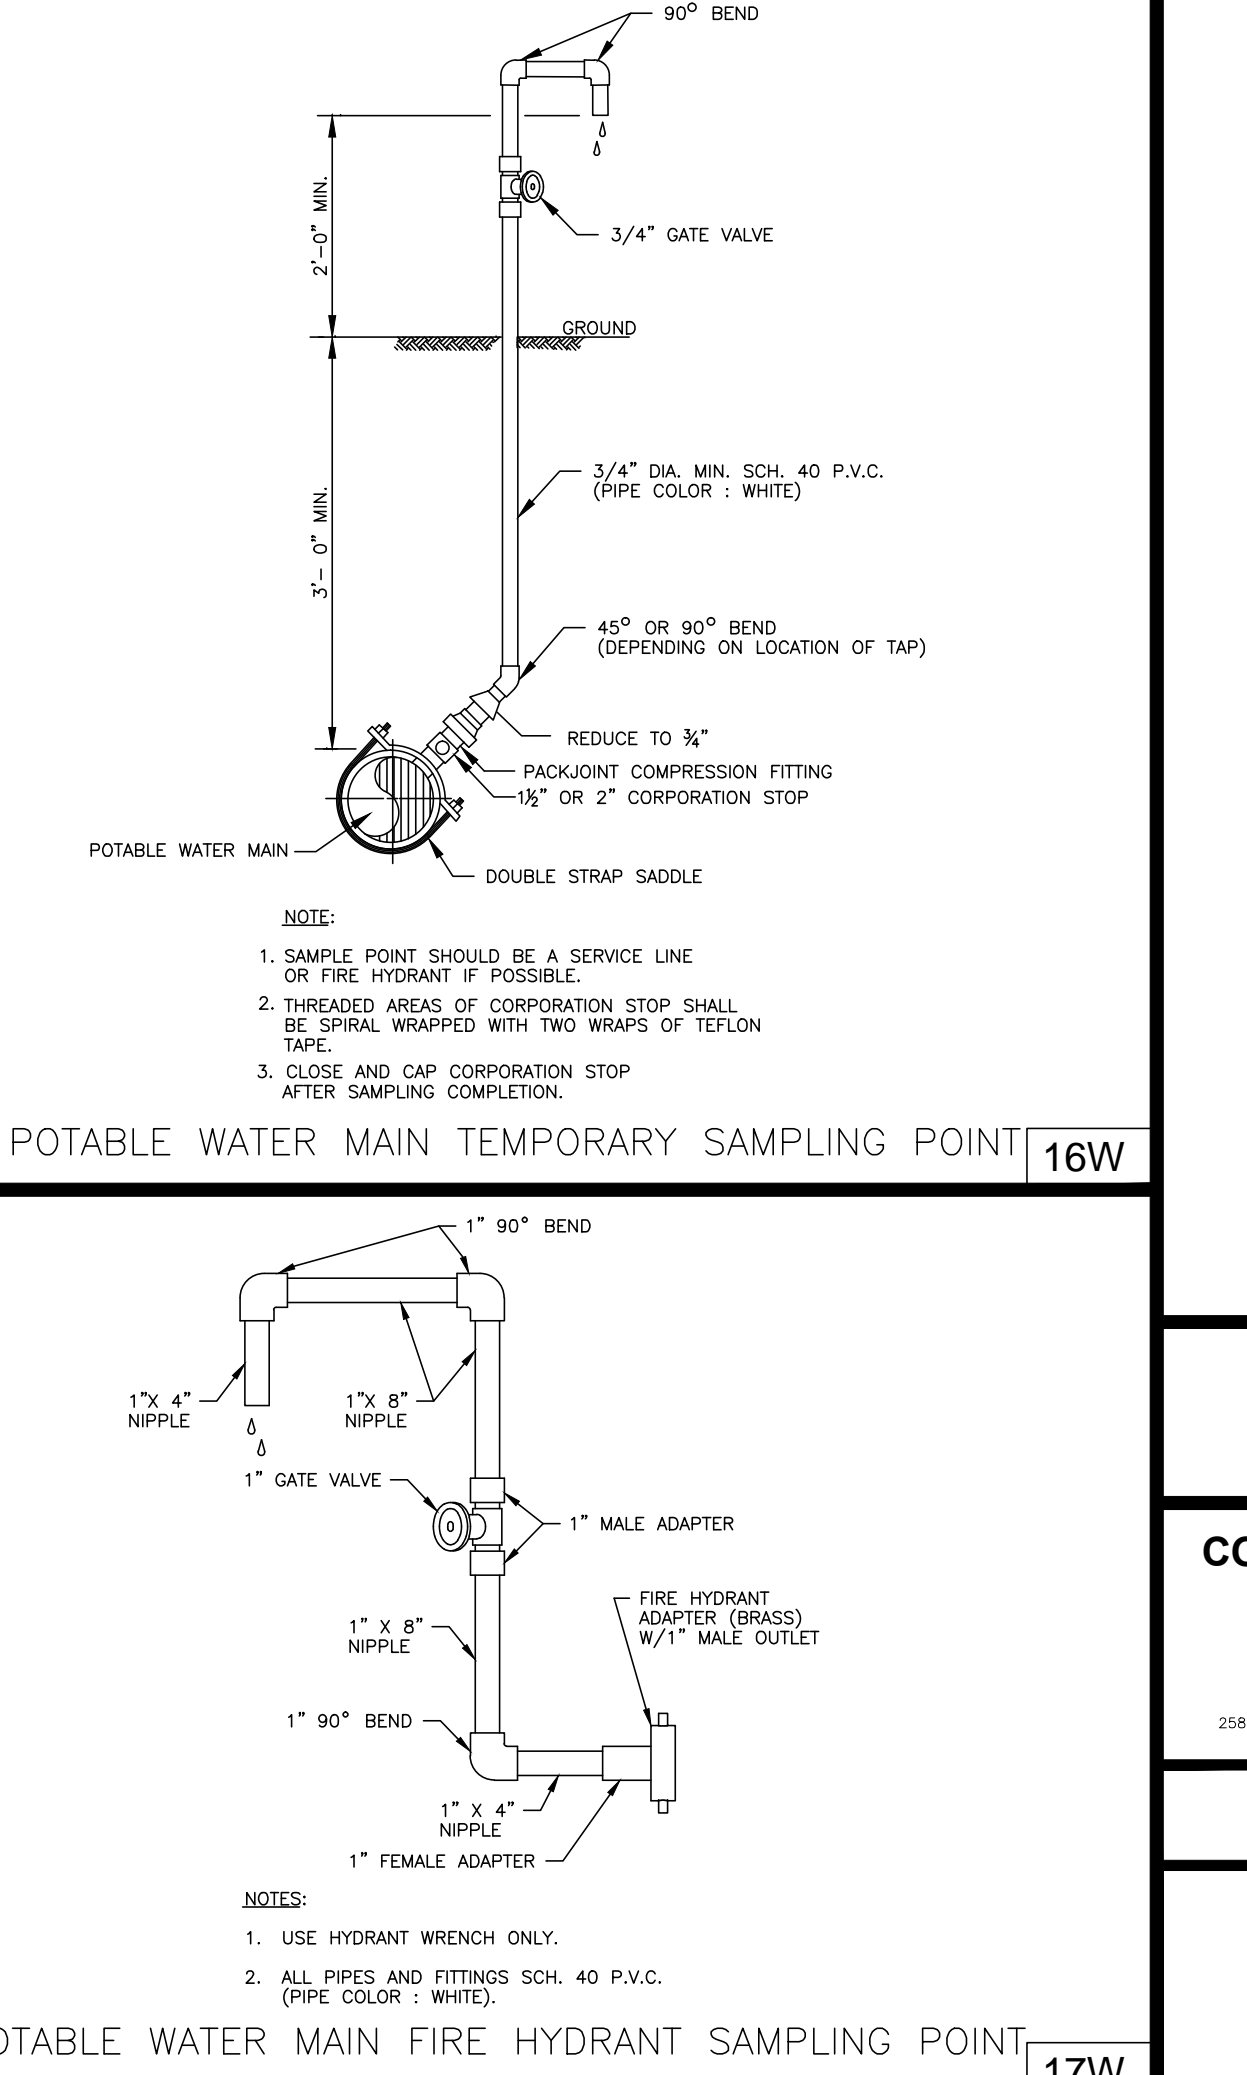

POTABLE WATER MAIN TEMPORARY SAMPLING POINT 16W

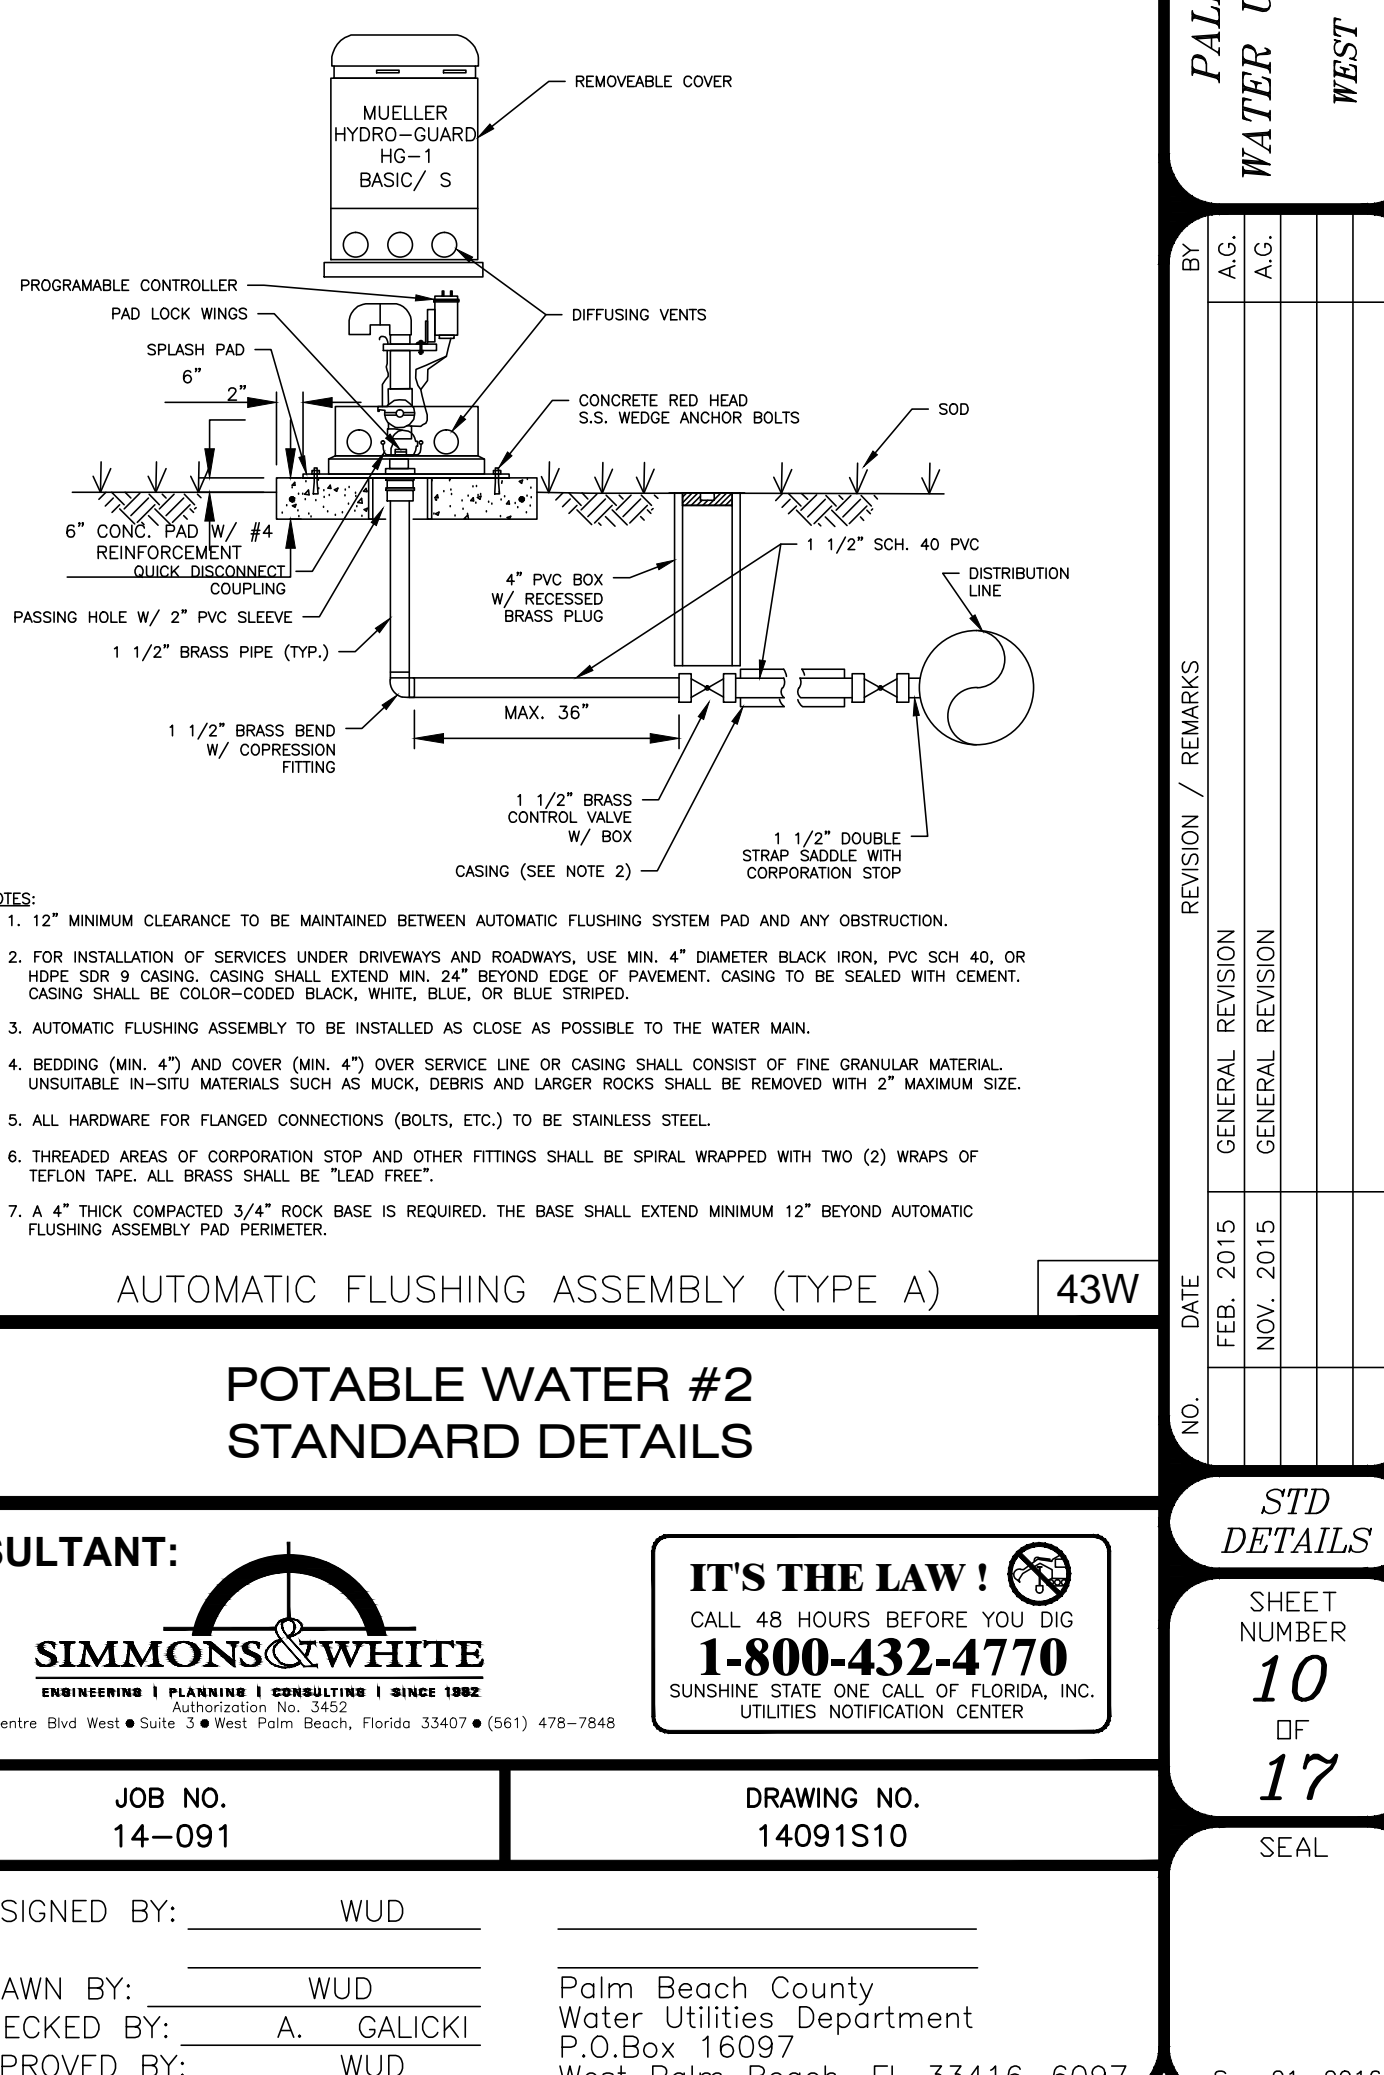

POTABLE WATER #2 STANDARD DETAILS 43W

CONSULTANT: SIMMONS & WHITE
 ENGINEERING & PLANNING CONSULTANTS SINCE 1982
 2581 Melrose Blvd West • Suite 3 • West Palm Beach, Florida 33407 • (561) 478-7848

IT'S THE LAW!
 CALL 48 HOURS BEFORE YOU DIG
 1-800-432-4770
 SUNSHINE STATE ONE CALL OF FLORIDA, INC.
 UTILITIES NOTIFICATION CENTER

DESIGNED BY: WUD
 DRAWN BY: WUD
 CHECKED BY: A. GALICKI
 APPROVED BY: WUD

JOB NO. 14-091
 DRAWING NO. 14091S10

DATE: FEB. 2015, NOV. 2015
 GENERAL REVISION, GENERAL REVISION

SHEET NUMBER 10 OF 17
 SEAL

Y:\AUTOCAD_FILES\2014\14-091\14091S09-17_WSD.dwg 9/21/2016 9:20 AM Tim Murch