01 TPO ROOFING SYSTEM OVER R-19 RIGID INSULATION ON GALVANIZED METAL DECK. PROVIDE TAPERED INSULATION TO FORM CRICKETS AND SLOPE TO DRAIN AS INDICATED.

02 4" CONCRETE SLAB ON 10 MIL VAPOR BARRIER ON COMPACTED, TERMITE TREATED FILL. SEE STRUCTURAL DRAWINGS.

03 DASHED LINE INDICATES SLAB TO BE POURED AT TIME OF TENANT BUILD OUT, POUR. INTERIOR TO REMAIN AS COMPACTED FILL.

04 0.050" PRE-FINISHED ALUMINUM COPING WITH WIND CLIPS AT 18" O.C. MAX. SEE DETAILS FOR MORE INFORMATION.

05 0.040" PRE-FINISHED ALUMINUM GUTTER. SEE DETAILS FOR MORE INFORMATION.

06 STRUCTURAL STEEL, SEE STRUCTURAL DRAWINGS, TYPICAL

07 EXTERIOR PAVEMENT SHOWN FOR REFERENCE ONLY AND MAY NOT REFLECT ACTUAL DESIGN INTENT. SEE CIVIL DRAWINGS AND LANDSCAPE DRAWINGS FOR ACCURATE INFORMATION. GC TO COORDINATE EXACT CONDITION. PROVIDE ASPHALT BOARD EXPANSION JOINT AT POURED IN PLACE PAVEMENT. RUN STUCCO TO 6" BELOW GRADE WHERE PAVEMENT / PAVERS ARE NOT PROVIDED.

08 6"x6" 0.040" PRE-FINISHED ALUMINUM DOWNSPOUT (NOT USED THIS SHEET)

09 STUCCO WITH SAND FINISH, PRIME & PAINT, TYPICAL AT ROOF SIDE OF HIGHER PARAPETS..

10 SURFACE MOUNTED WALL SCONCES, SEE ELEVATIONS AND SECTIONS, TYPICAL. (SEE ELECTRICAL DRAWINGS)

11 3/4" STUCCO ON GALV. P.B. MTL. LATH ON 15# FELT ON 8" CMU

12 "FOAM-IN" INSULATION (R-6 APPROXIMATE VALUE)

13 TPO ROOFING SYSTEM, RUN UP WALL TO FLASHING OR COPING AS INDICATED.

14 0.024" PRE-FINISHED ALUMINUM GRAVEL STOP (NOT USED THIS SHEET)

15 PT WOOD BLOCKING

16 STAINLESS STEEL TERMINATION BAR

17 TPO ROOFING BASE FLASHING

18 SEALANT

19 SEE STRUCTURAL DRAWINGS FOR CLIP ANGLES, LEDGERS, KNOCK-OUT BLOCKS, LINTELS, FILLED CELLS, ANCHORAGE AND REINFORCEMENT.

20 DASHED LINE AT INTERIOR OF EXTERIOR WALL DENOTES FUTURE 5/8" GWB ON 3-5/8" GALV. METAL STUD FURRING WITH 3-1/2" BATT INSULATION (R-11 NOMINAL) TO BE INSTALLED AS PART OF TENANT BUILD-OUT (N.I.C. FOR SHELL CONTRACT)), TYPICAL

21 ASPHALT BOARD EXPANSION JOINT (NOT USED THIS SHEET)

22 ALUMINUM AND GLASS STOREFRONT SYSTEM

23 THRU WALL 8"x16" ROOF SCUPPER FORMED FROM 0.024" PRE-FINISHED ALUMINUM, CONNECT TO COLLECTION BOX FORMED FROM 0.063" PRE-FINISHED ALUMINUM. SEE DETAIL 5/A3.01 FOR MORE INFORMATION (NOT USED THIS SHEET)

25 "RODDED" DRIP (NOT USED THIS SHEET)

26 SILL FLASHING PER STOREFRONT MANUFACTURER'S REQUIREMENTS (NOT USED THIS SHEET)

27 FOUNDATION, SEE STRUCTURAL DRAWINGS

28 PRE-ENGINEERED CANOPY SYSTEM

29 NOT USED

30 NOT USED

31 NOT USED

32 3"x8" PRE-ENGINEERED ALUMINUM STRUCTURAL SUPPORT BRACE ASSEMBLY, PRIME & PAINT. SEE DETAIL 6/A3.11 AND STRUCTURAL DRAWINGS FOR MORE INFORMATION, TYPICAL

KEY NOTES (XX) REFERENCED BY THIS SYMBOL

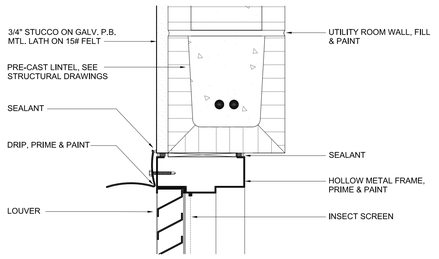

HEAD DETAIL — SCALE 3" = 1'-0" — 5

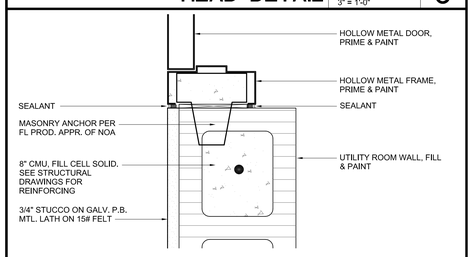

JAMB DETAIL — SCALE 3" = 1'-0" — 4

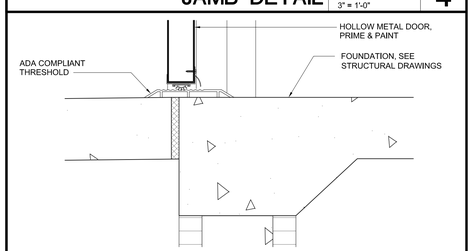

SILL DETAIL — SCALE 3" = 1'-0" — 3

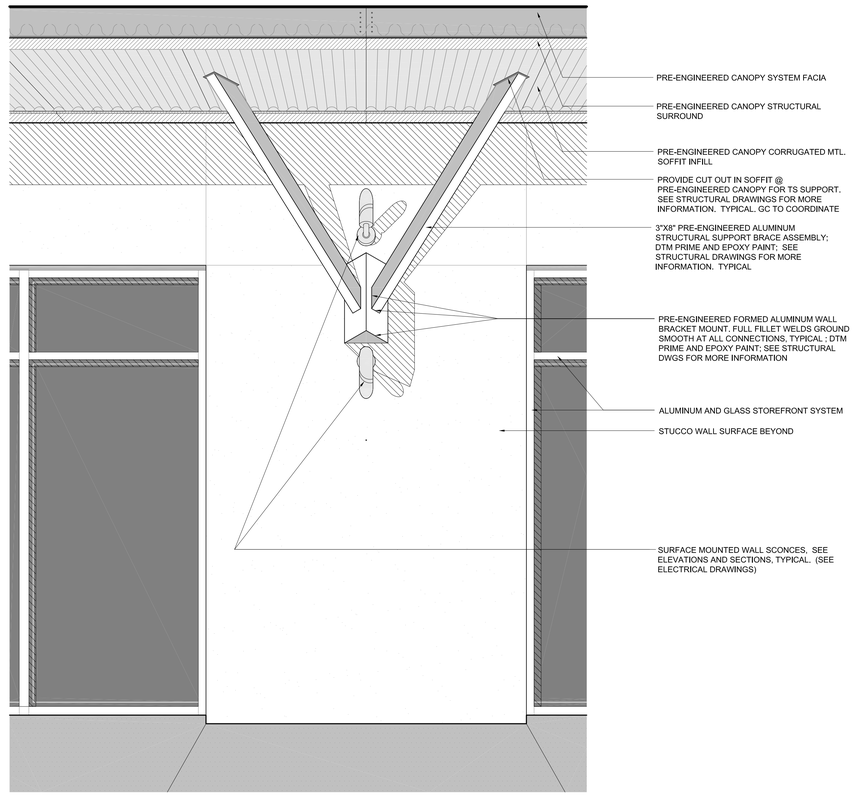

PERSPECTIVE ELEVATION DETAIL — SCALE NTS — 6

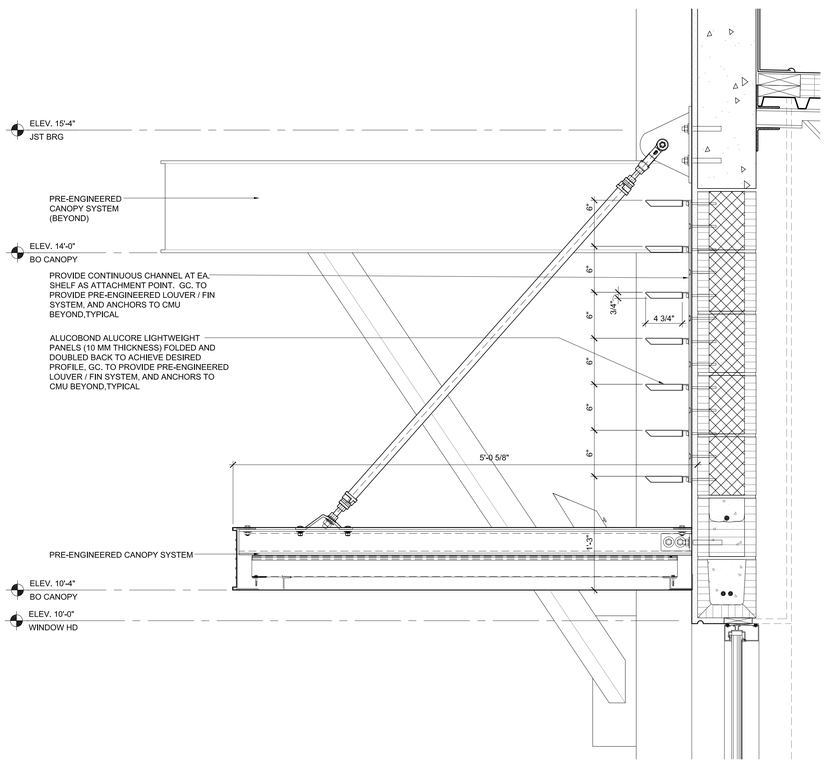

SECTION DETAIL — SCALE 1 1/2" = 1'-0" — 2

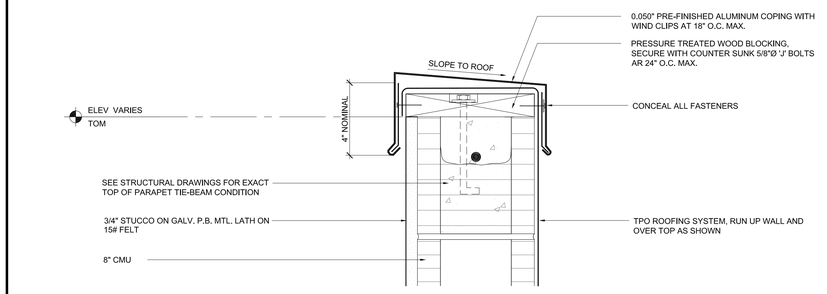

TYPICAL COPING DETAIL — SCALE 3" = 1'-0" — 7

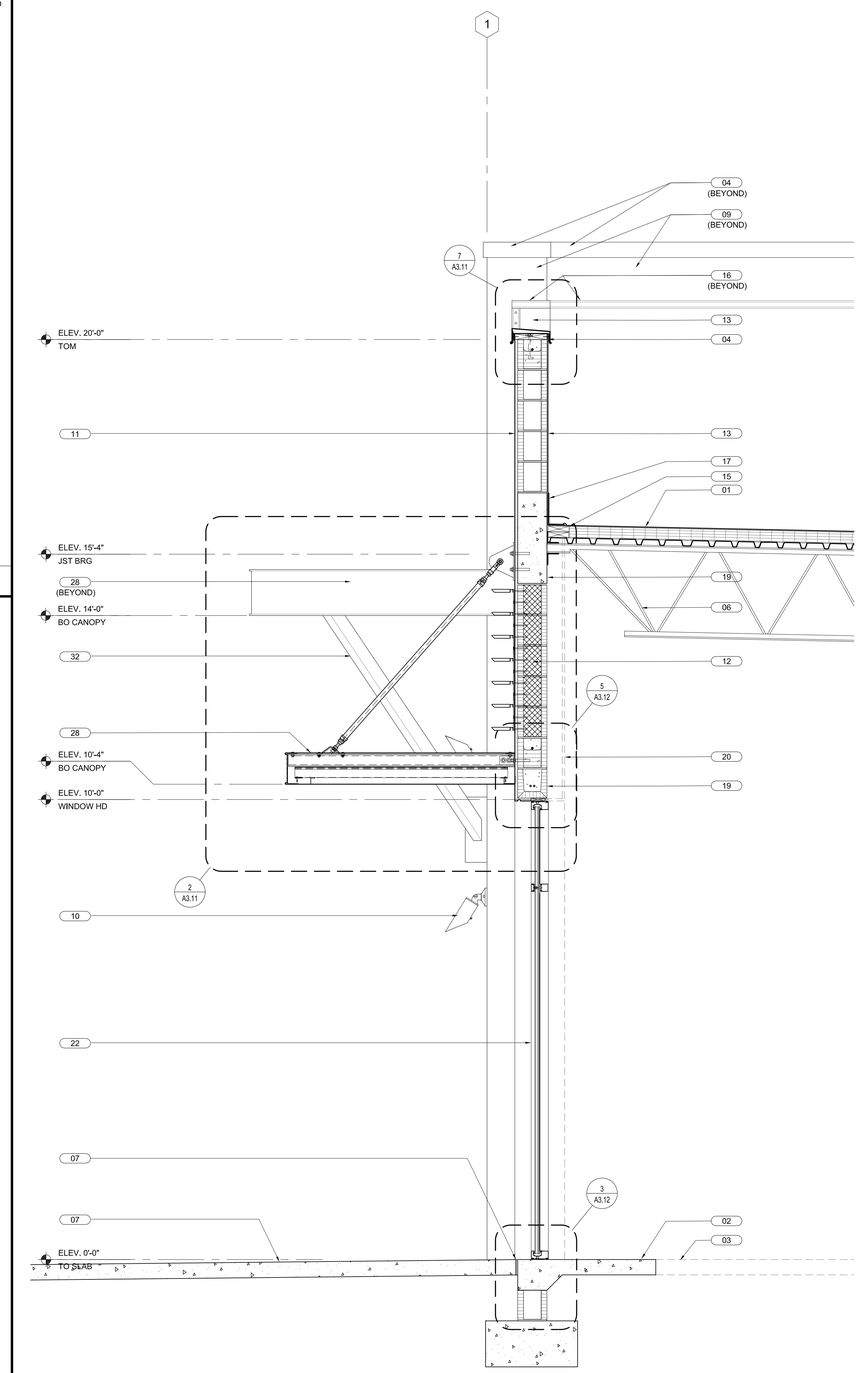

WALL SECTION — SCALE 3/4" = 1'-0" — 1

api(+)
2709 Rocky Point Dr. 201 T 813 + 281 9299
Tampa, Florida 33607 USA F 813 + 281 9292
License No AAC001935 apiplus.com

BULLETIN LOG

minto

WESTLAKE AUXILIARY SALES CENTER

CITY OF WESTLAKE
PALM BEACH COUNTY, FLORIDA

ISSUE DATE: - 09-30-16
ISSUED FOR:
PERMIT - BUILDING SHELL ONLY

©AS DATED ARCHITECTURE PLUS INTERNATIONAL, INC.

REVISION LOG

STATE REGISTRATIONS

FL #AAC001935 NC #8581
SC #6109 GA #10079
TN #00102675

Juan F. Romero AIA, License No. AR0007793
TO THE BEST OF THE KNOWLEDGE OF THE ARCHITECTS AND ENGINEERS, SAID PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AND THE APPLICABLE MINIMUM FIRE SAFETY STANDARDS.

WESTLAKE AUXILIARY SALES CENTER
PROJECT NAME

WALL SECTIONS / DETAILS
SHEET NAME

PROJECT NUMBER: 2016.082
DRAWN BY: PC CHECKED BY: PC
SCALE:

A3.11
SHEET NUMBER