
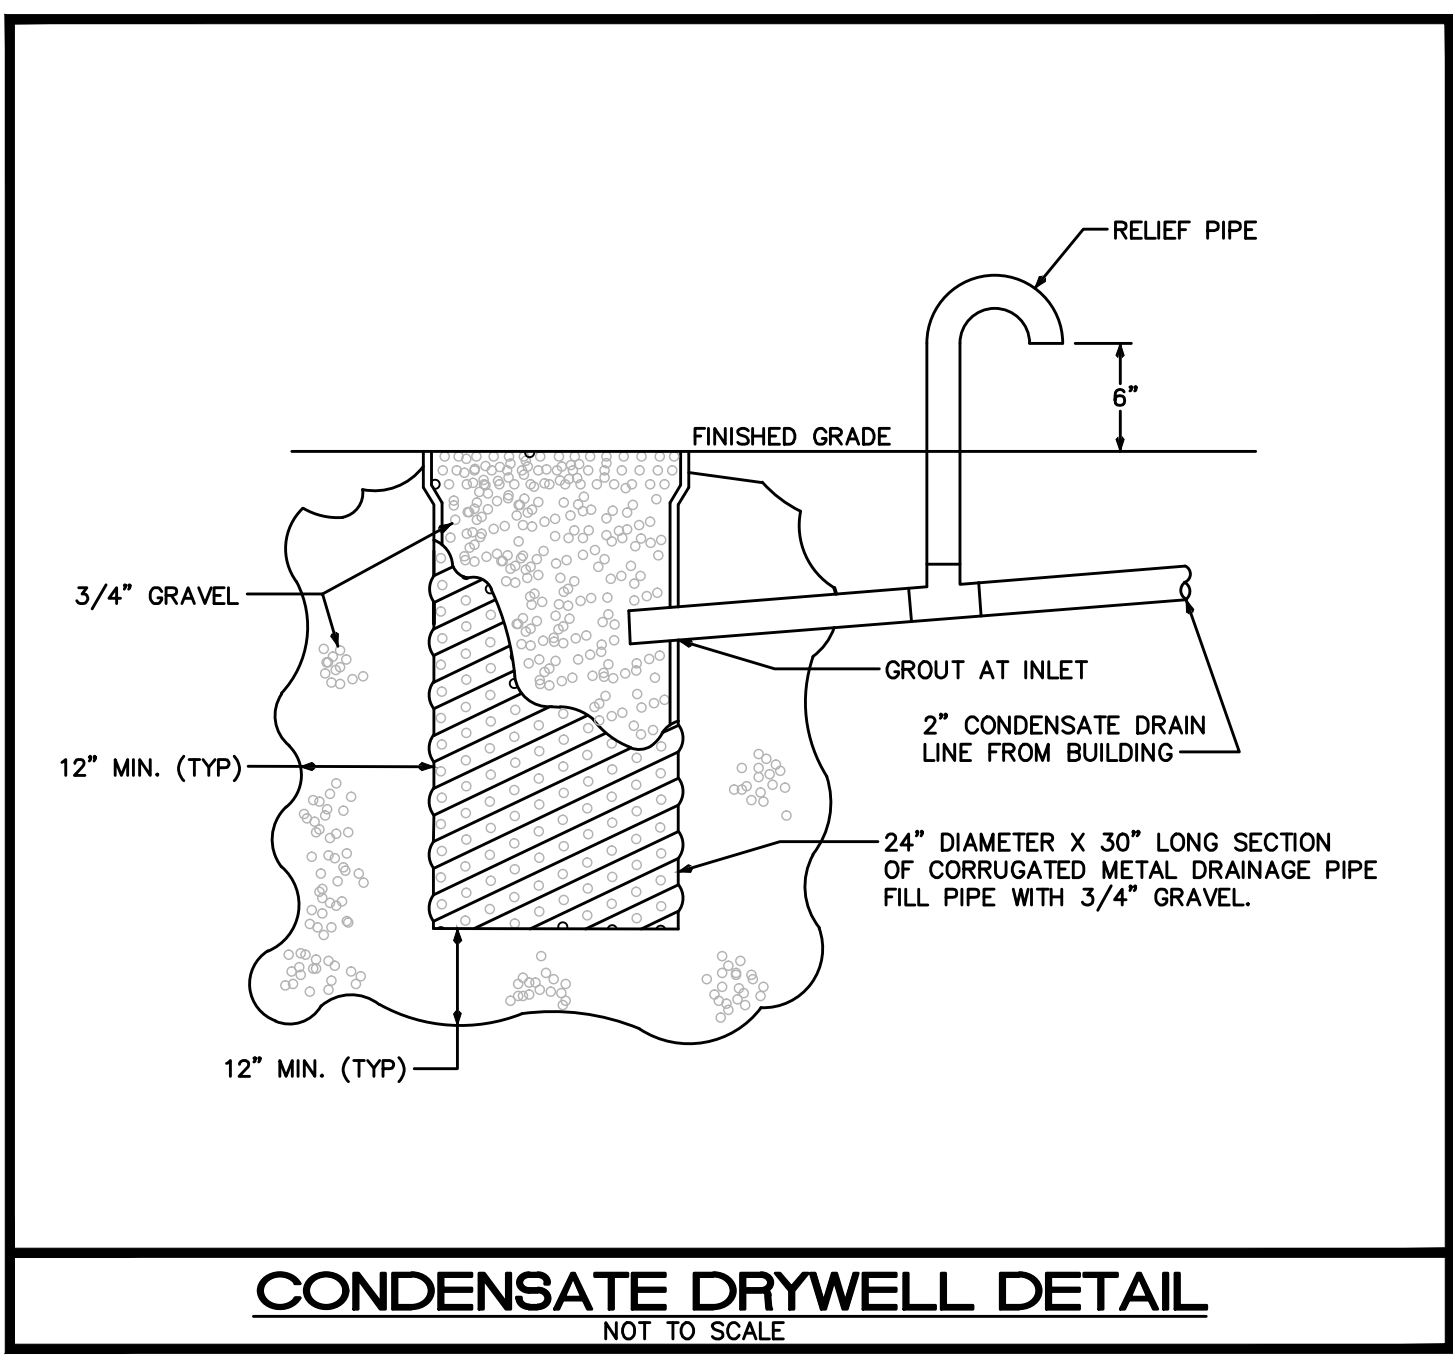


CONDENSATE DRAIN PIPE SIZING	
HVAC EQUIPMENT CAPACITY	MINIMUM CONDENSATE PIPE DIAMETER
UP TO 20 TONS OF REFRIGERATION	1"
OVER 21 TONS TO 40 TONS OF REFRIGERATION	1-1/4"
OVER 41 TONS TO 60 TONS OF REFRIGERATION	1-1/2"
OVER 61 TONS TO 100 TONS OF REFRIGERATION	2"
OVER 101 TONS TO 250 TONS OF REFRIGERATION	3"
OVER 251 TONS & LARGER OF REFRIGERATION	4"

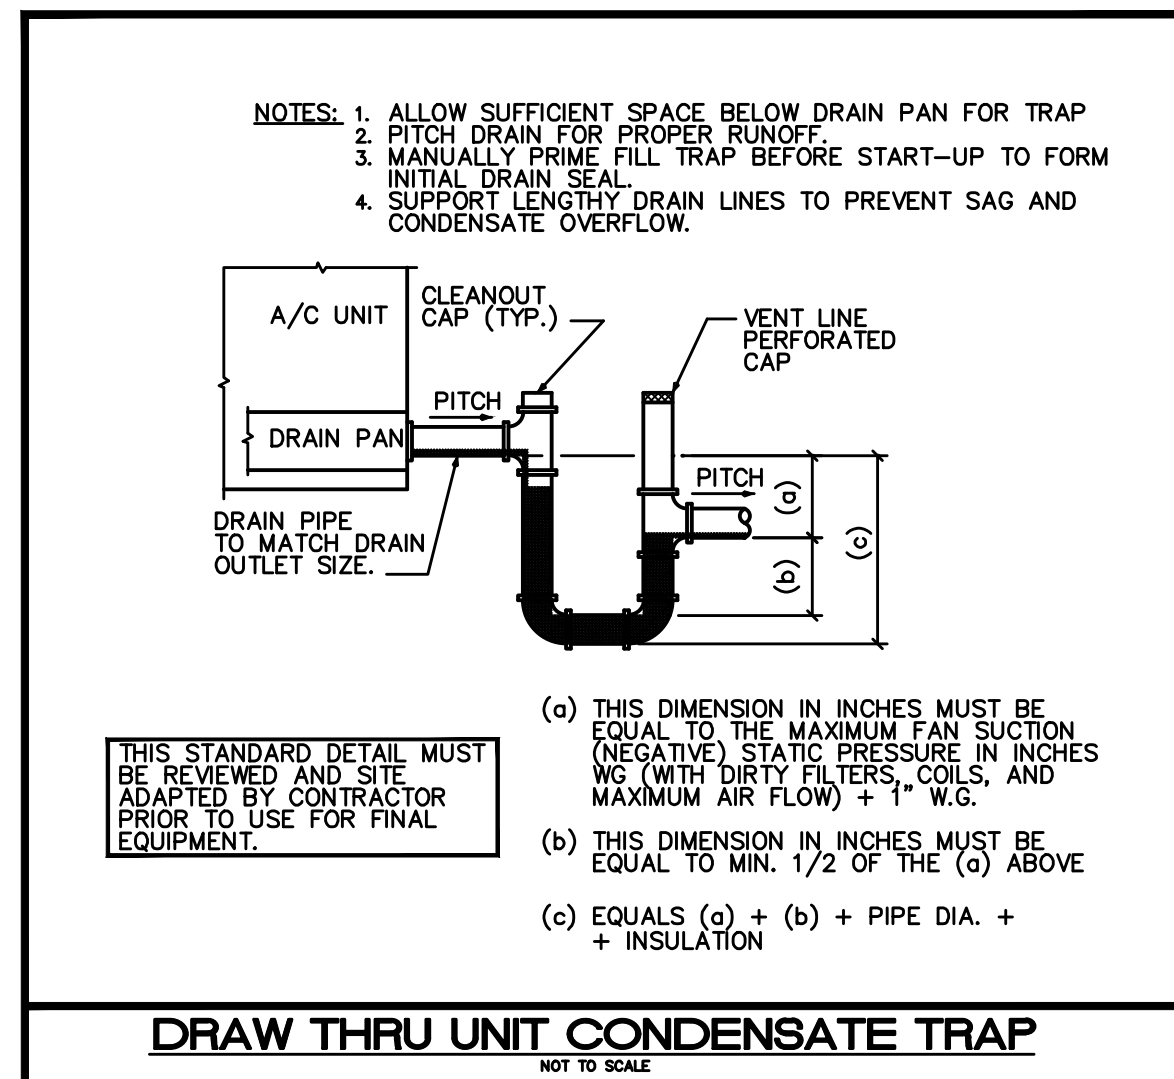

REVISIONS	BY

Slattery & Associates
 ARCHITECTS
 PLANNERS
 2060 NW BOCA RATON BLVD.
 SUITE 2
 BOCA RATON, FL 33431
 TEL: 561-392-3848
 FAX: 561-392-5402
 WWW.SLATTERYARCHITECTS.COM

ACTIVITY CENTER
 FOR
 FLORENCE FULLER CHILD DEVELOPMENT CENTERS
 WEST CAMPUS
 S.W. 185TH STREET
 BOCA RATON, PALM BEACH COUNTY, FLORIDA

BIDDING
 NOT FOR
 CONSTRUCTION
 DATE OF SEAL: 4/2/08
 SLATTERY & ASSOCIATES
 FLORIDA REGISTRATION # AA0003381

ISSUED FOR PERMIT
 ISSUED FOR CONSTRUCTION

KAMM CONSULTING PROJECT # 2016-0024
 PRODUCT MANAGER: JOHN CHIRGWIN

1407 West Newport Center Drive
 Deerfield Beach, Florida 33442
 Phone 954.949.2200 Fax 954.949.2201
 engineering@kammconsulting.com
 Certification of Authorization #8189

KAMM Consulting

10.21.16
 date
 signed

PLUMBING DETAILS

DRAWN	JWC/PG/AE
CHECKED	AK/MP
DATE	10-21-16
SCALE	AS NOTED
JOB NO.	2011-64
SHEET	P0.2

PHASE: C.D. SET 10-21-16